APW - VERTICAL PUMPS

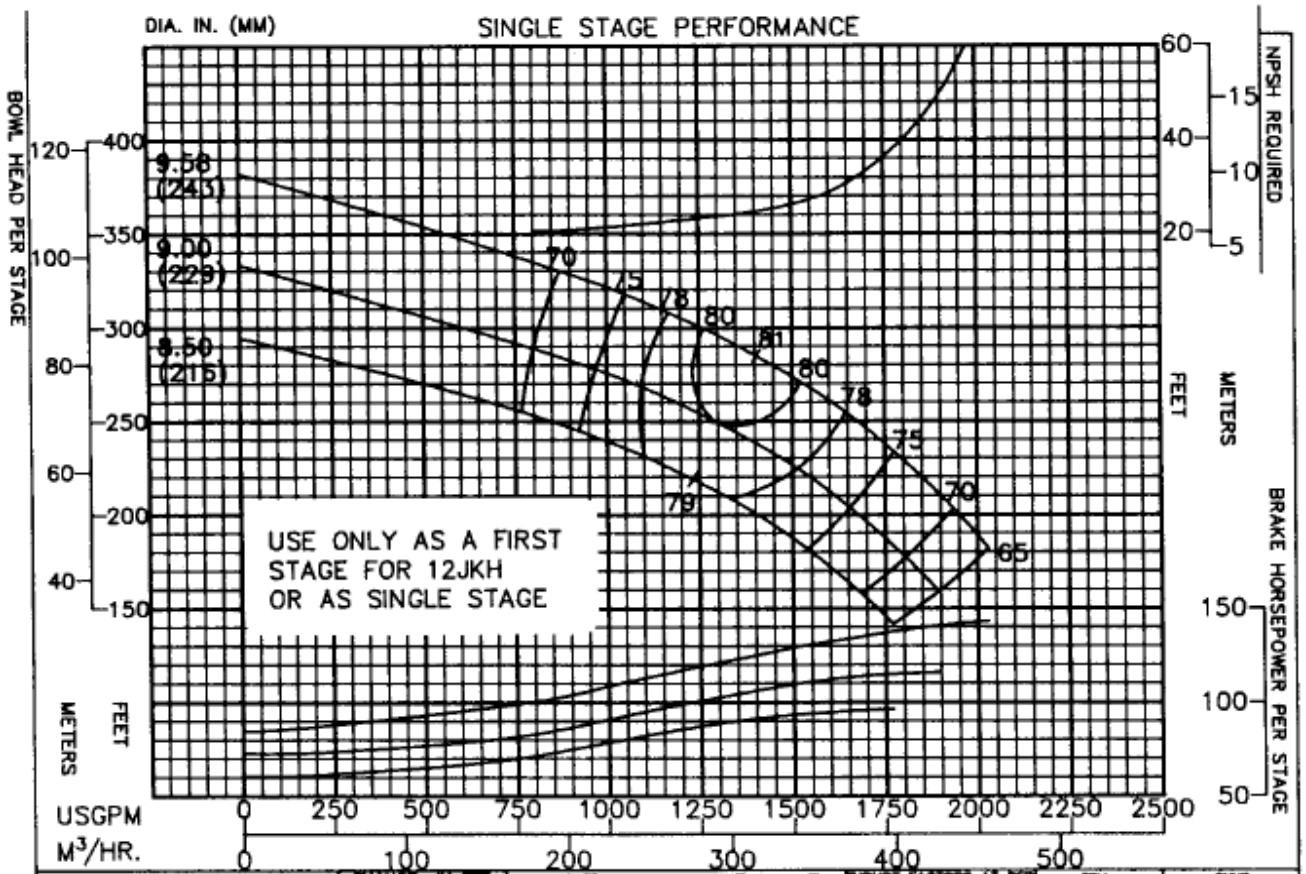

PERFORMANCE BASED ON PUMPING CLEAR WATER BELOW 85°F. WITH LISTED MATLS. COLUMN LOSSES NOT INCLUDED.	CHANGE STAGES 1	IN DEF. POINTS 0	INGERSOLL-RAND PUMPS VERTICAL PUMP DIVISION HASTINGS, NE	THRUST FACTORS AT BEP: IMPELLER LBS/FT KG/M; STANDARD 7.1 10.6; BALANCED -- --	RPM 3550	PUMP 12JKYH
BOWL – CAST IRON – LINED				EYE AREA–20.5 SQ. IN.	ENCLOSED IMPELLER N_{ss} = 1920	CURVE NO. EC–1424
IMPELLER – BRONZE						