


PUMPS VERTICAL PUMPS

155.00
New Sheet
Dated May 24, 1991

NPSH REQUIRED

BRAKE HORSEPOWER PER STAGE

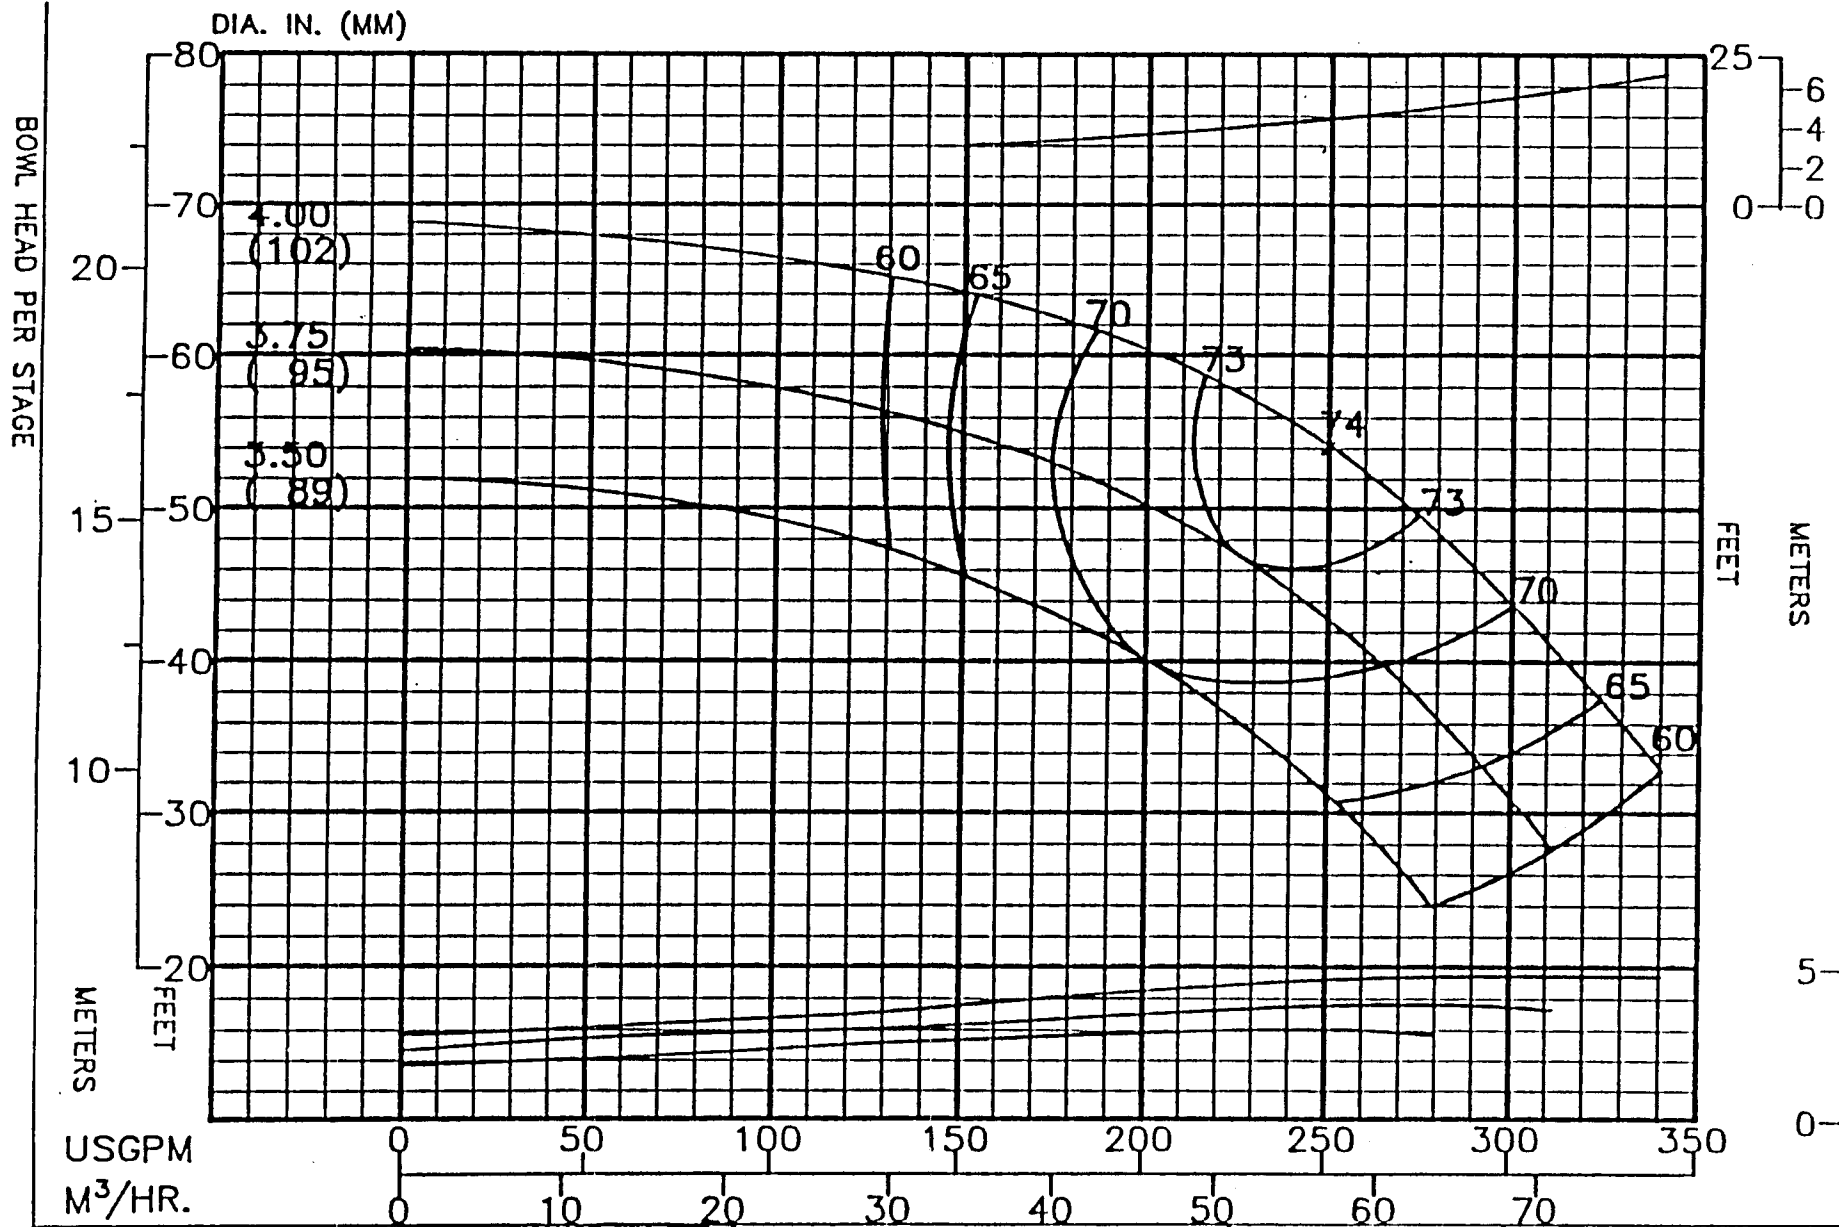

PERFORMANCE BASED ON PUMPING
CLEAR WATER BELOW 85°F. WITH LISTED
MATS. COLUMN LOSSES NOT INCLUDED.

BOWL - CAST IRON	CHANGE IN EFF.	IN EFF.
IMPELLER - BRONZE	STAGES	POINTS
	1	-5
	2	-4
	3	-2
	4	-1

INGERSOLL-RAND
PUMPS
VERTICAL PUMP DIVISION
HASTINGS, NE

THRUST FACTORS AT BEP		
IMPELLER	LBS/FT	KG/M
STANDARD	3.1	4.6
BALANCED	---	---
EYE AREA-5.2	SQ. IN.	

RPM	3500
SEMIOPEN IMPELLER	
N _s - 2780	

PUMP	6EH
CURVE NO.	EC-1892