APW - VERTICAL PUMPS

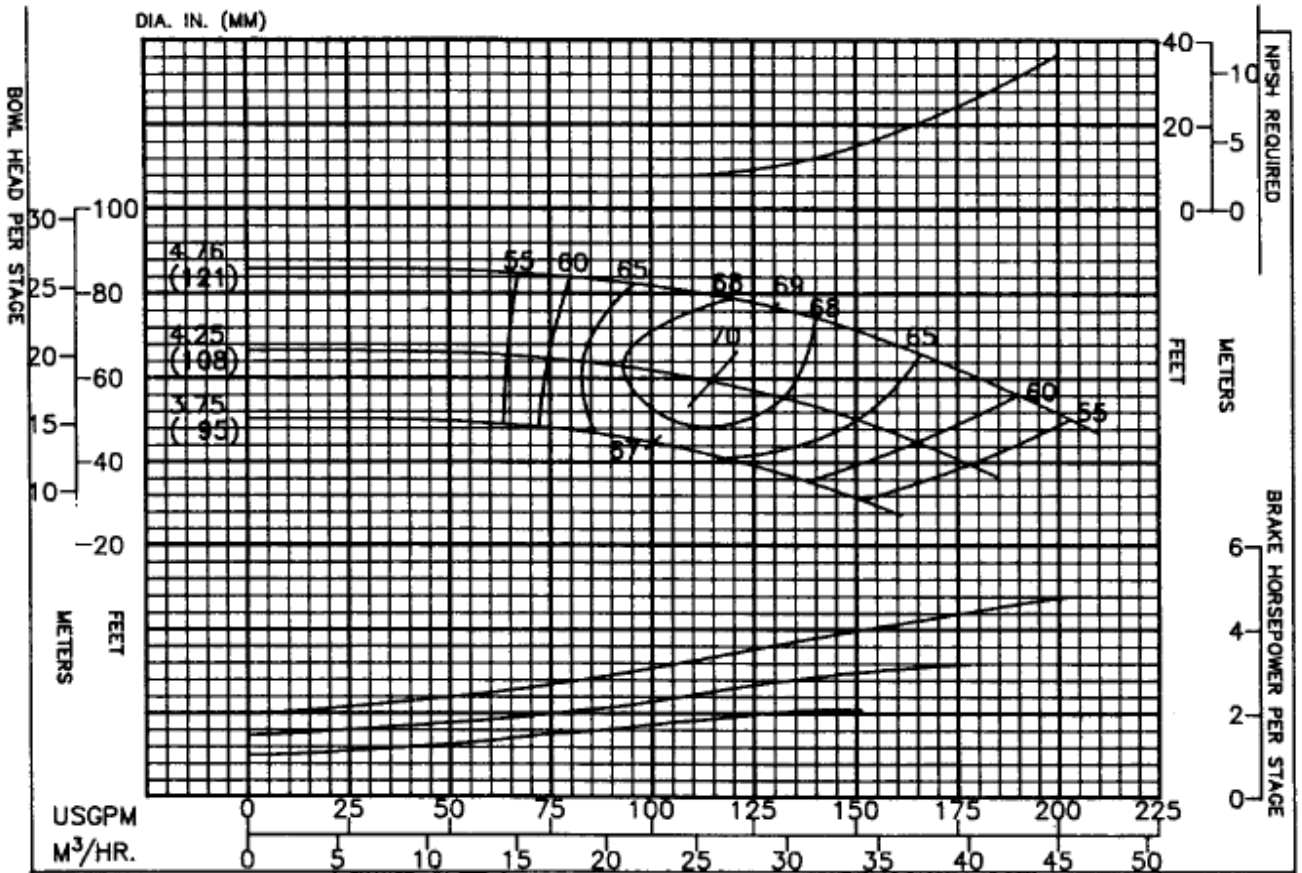

PERFORMANCE BASED ON PUMPING CLEAR WATER BELOW 85°F. WITH LISTED MATLS. COLUMN LOSSES NOT INCLUDED.	CHANGE IN DEF. STAGES	POINTS
	1	3
BOWL – CAST IRON – LINED	2	2
IMPELLER – BRONZE	3	2
	4	1

INGERSOLL-RAND
PUMPS
VERTICAL PUMP DIVISION
HASTINGS, NE

THRUST FACTORS AT BEP		
IMPELLER	LBS/FT	KG/M
STANDARD	1.00	1.49
BALANCED	.30	.45
EYE AREA–2.91 SQ. IN.		

RPM	PUMP
3500	6JKH
ENCLOSED IMPELLER	CURVE NO.
N_s = 1535	EC–1358