APW - VERTICAL PUMPS

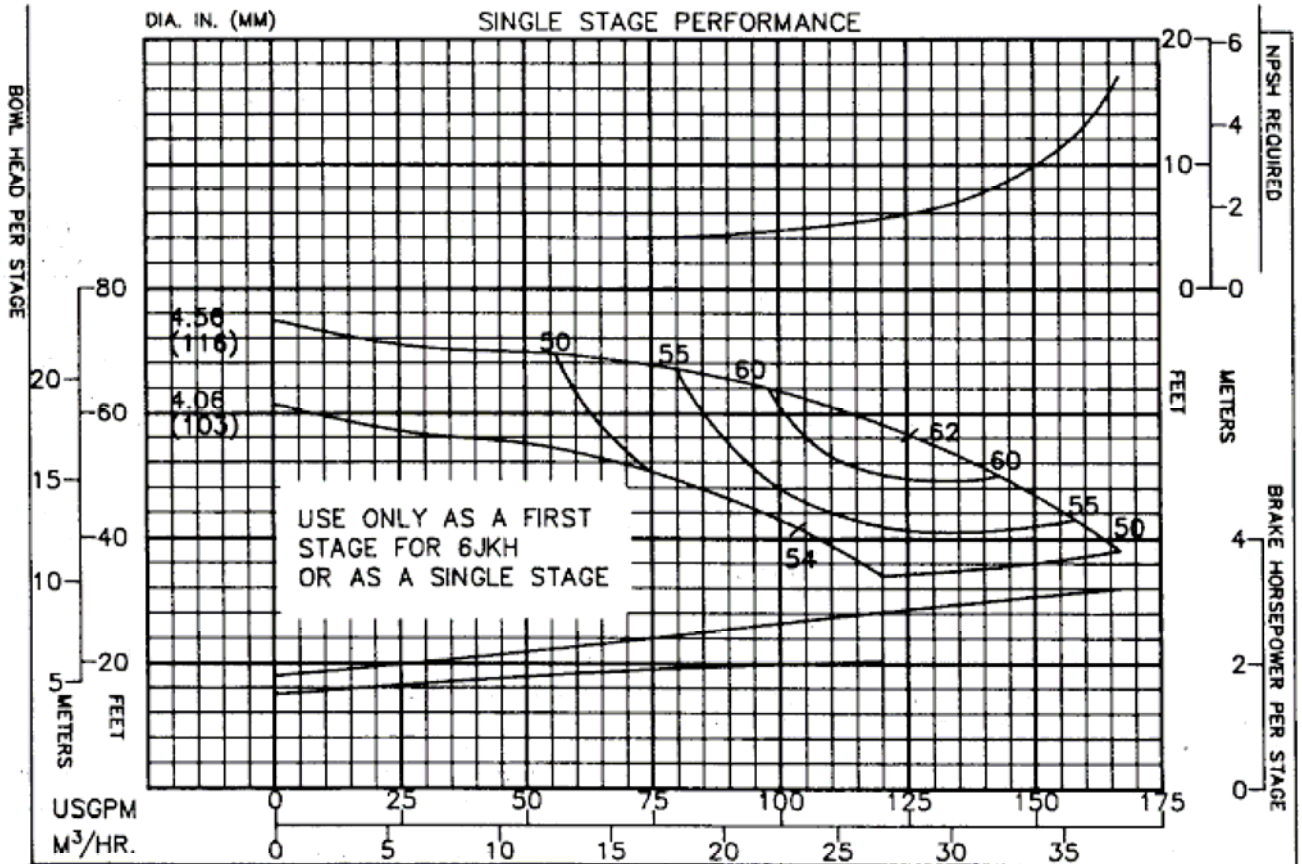

PERFORMANCE BASED ON PUMPING CLEAR WATER BELOW 85°F. WITH LISTED MATLS. COLUMN LOSSES NOT INCLUDED.	CHANGE IN EFF. STAGES / POINTS	INGERSOLL-RAND PUMPS VERTICAL PUMP DIVISION HASTINGS, NE	THRUST FACTORS AT BEP: IMPELLER LBS/FT KG/M; STANDARD 1.8 2.7; BALANCED -- --; EYE AREA-4.8 SQ. IN.	RPM 3500	PUMP 6JKYH	
BOWL - CAST IRON - LINED				ENCLOSED IMPELLER	CURVE NO. EC-1401	
IMPELLER - BRONZE				N_s - 1890		