# APW - VERTICAL PUMPS



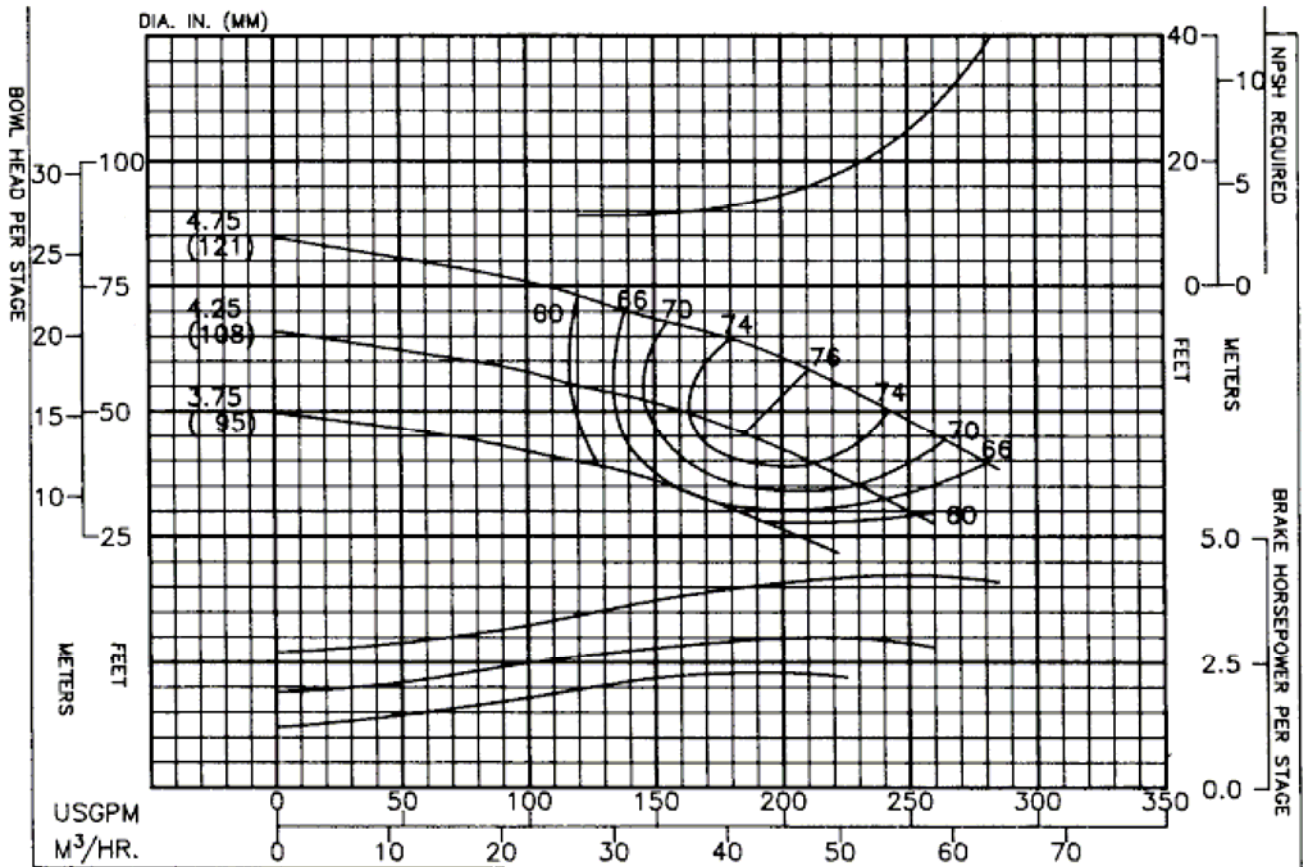


| PERFORMANCE BASED ON PUMPING CLEAR WATER BELOW 85°F. WITH LISTED MATLS. COLUMN LOSSES NOT INCLUDED. | CHANGE STAGES | IN EFF. POINTS |
|---|---|---|
| | 1 | 2 |
| BOWL – CAST IRON – LINED | 2 | 4 |
| | 3 | 3 |
| IMPELLER – BRONZE | 5 | 1 |

INGERSOLL-RAND
PUMPS
VERTICAL PUMP DIVISION
HASTINGS, NE

| THRUST FACTORS AT BEP | | |
|---|---|---|
| IMPELLER | LBS/FT | KG/M |
| STANDARD | 1.50 | 2.24 |
| BALANCED | 1.10 | 1.64 |
| EYE AREA–4.3 SQ. IN. | | |

| RPM | PUMP |
|---|---|
| 3500 | 6KKH |
| ENCLOSED IMPELLER | CURVE NO. |
| $N_s$ = 2410 | EC--1360 |