APW - VERTICAL PUMPS

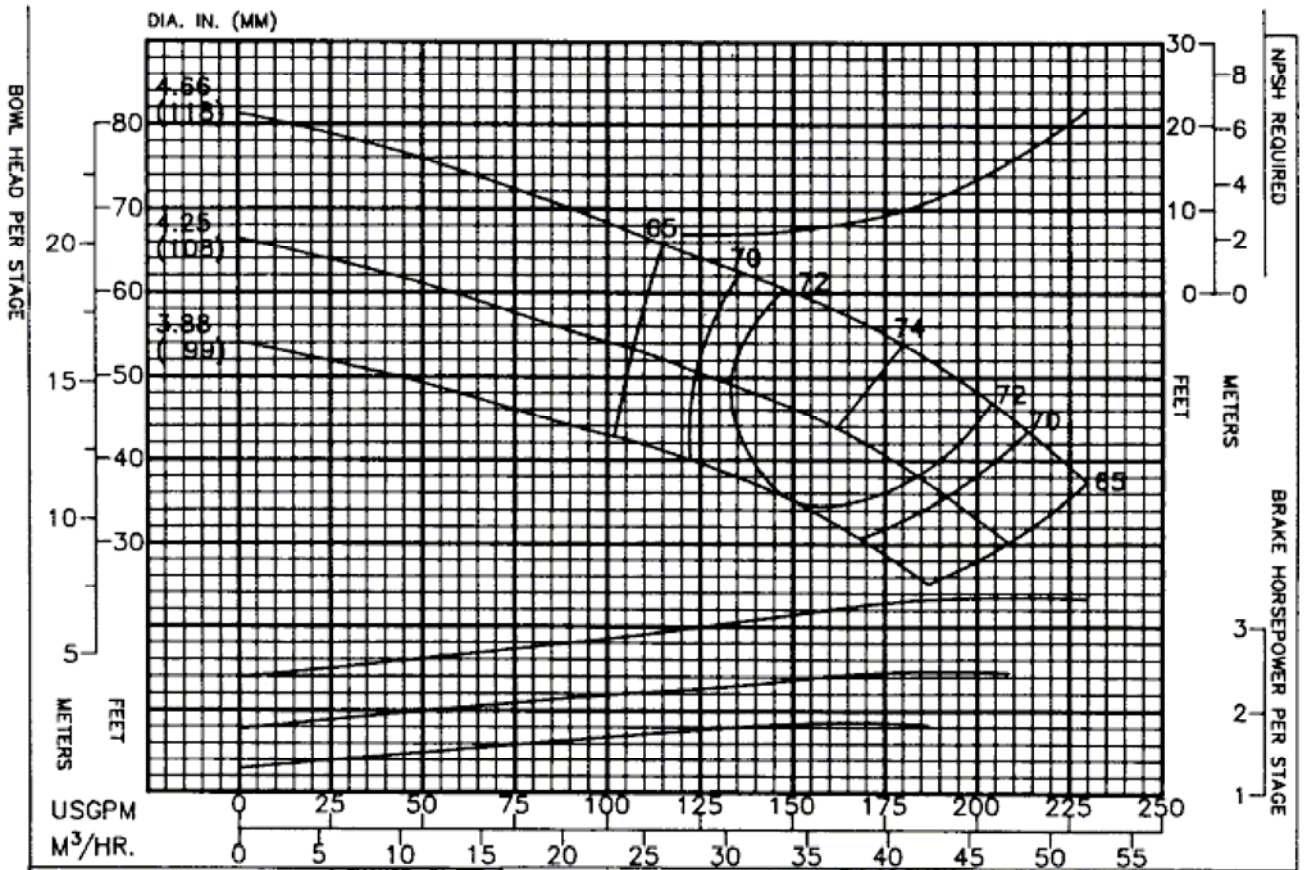

PERFORMANCE BASED ON PUMPING CLEAR WATER BELOW 85°F. WITH LISTED MATLS. COLUMN LOSSES NOT INCLUDED.	CHANGE STAGES	IN EFF. POINTS
BOWL – CAST IRON – LINED	1	−3
IMPELLER – BRONZE	2	−2
	3	−2
	4	−1

INGERSOLL-RAND
PUMPS
VERTICAL PUMP DIVISION
HASTINGS, NE

THRUST FACTORS AT BEP		
IMPELLER	LBS/FT	KG/M
STANDARD	2.10	3.10
BALANCED	1.10	1.64
EYE AREA – 4.32 SQ. IN.		

RPM	PUMP
3500	6KKL
ENCLOSED IMPELLER	CURVE NO.
N_s = 2360	EC–1450