APW - VERTICAL PUMPS

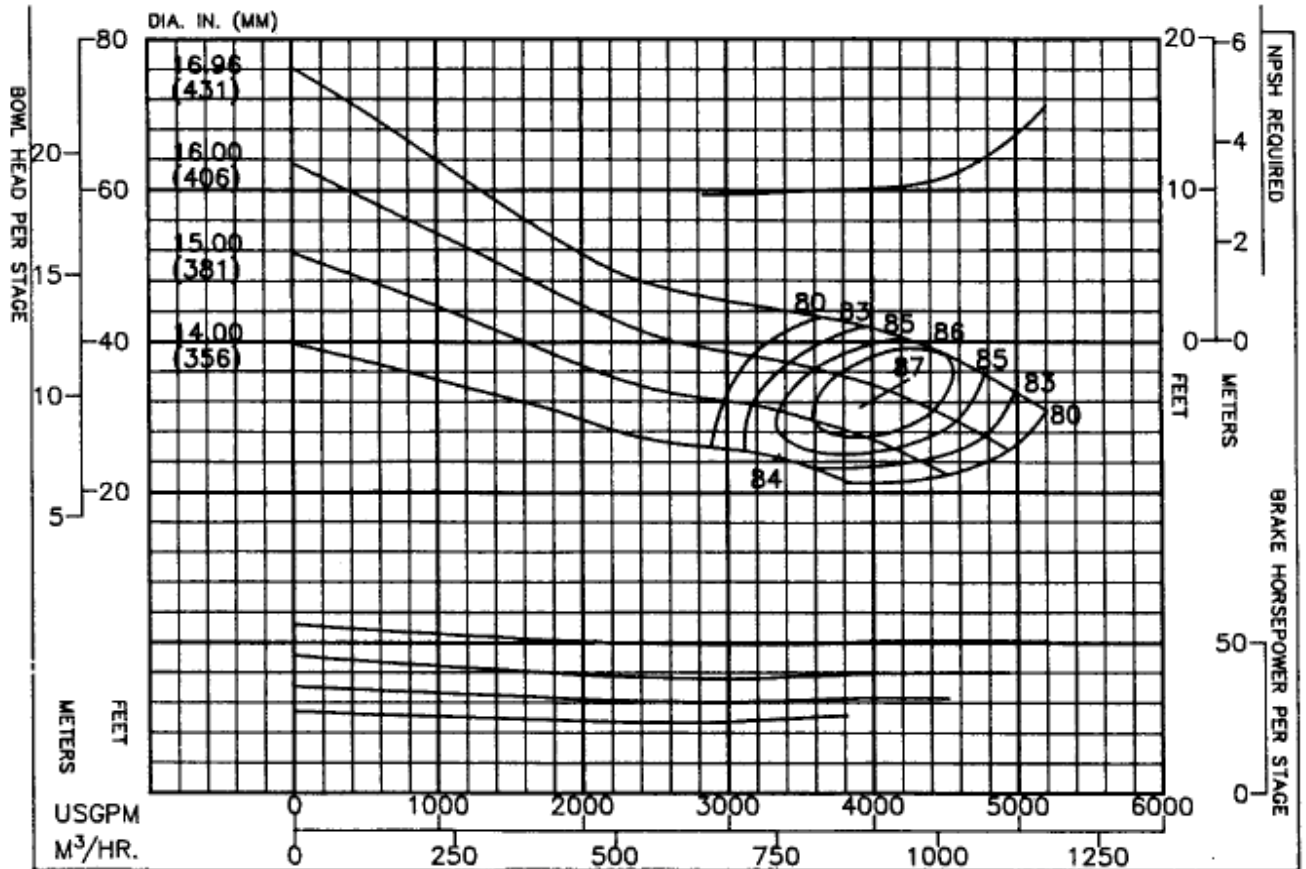

PERFORMANCE BASED ON PUMPING CLEAR WATER BELOW 85°F. WITH LISTED MATLS. COLUMN LOSSES NOT INCLUDED.	CHANGE IN PER.		INGERSOLL-RAND PUMPS VERTICAL PUMP DIVISION HASTINGS, NE	THRUST FACTORS AT BEP		RPM	PUMP
	STAGES	POINTS		IMPELLER LBS/FT	KG/M	880	20NKL
BOWL – CAST IRON – LINED	2	0		STANDARD 31.0	46.2	ENCLOSED IMPELLER	CURVE NO.
IMPELLER – BRONZE				BALANCED 22.4	33.4		EC–1398
				EYE AREA–87.8 SQ. IN.		N_s = 3630	