


CURVE NO. 10H3AD-1

Test No. 1267 & 1299

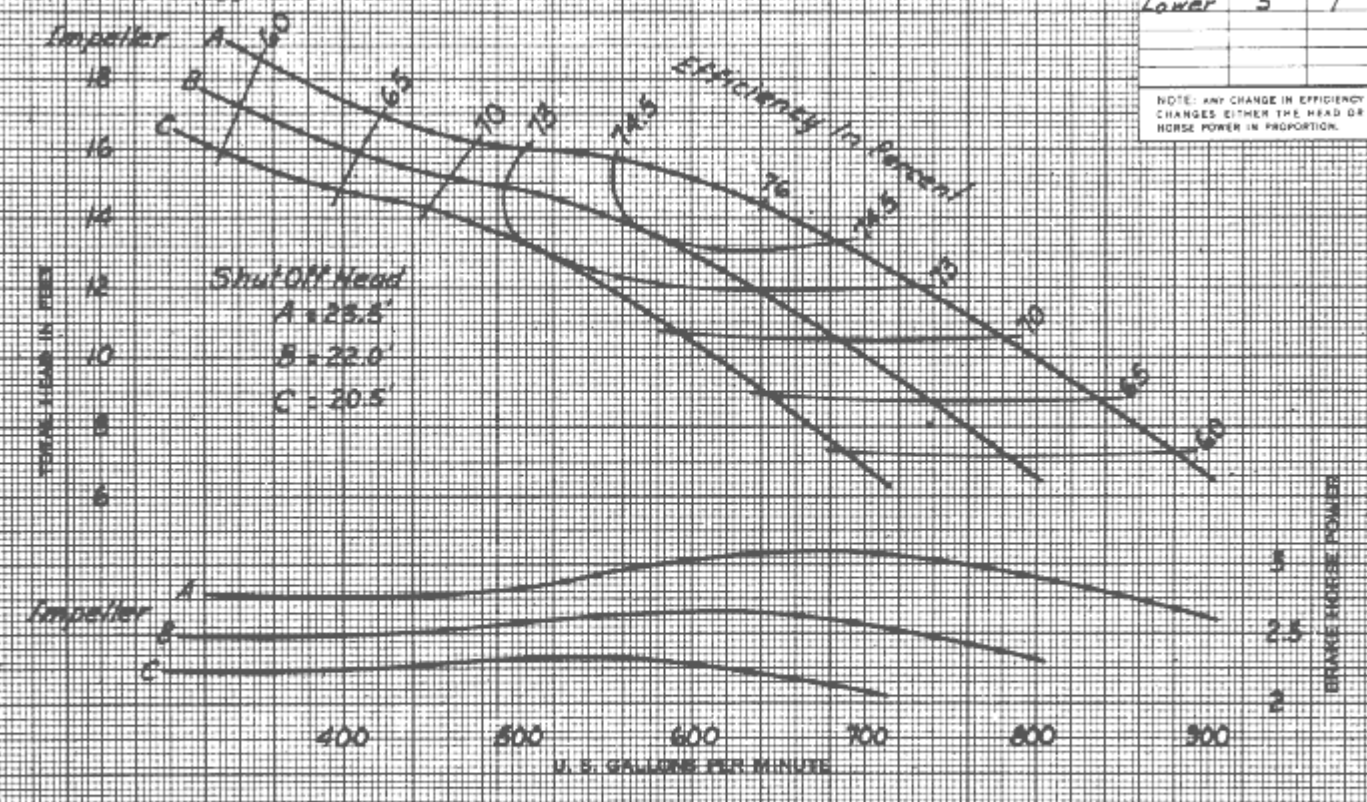

CHANGE EFFICIENCY IS FOLLOWS	NUMBER OF POINTS	FOR NUMBER OF STAGES
Lower	1	2
Lower	5	1

NOTE: ANY CHANGE IN EFFICIENCY
 CHANGES EITHER THE HEAD OR
 HORSE POWER IN PROPORTION.

HYDRAULIC PERFORMANCE is contingent on the well furnishing the pump with the specified amount of clear, fresh, non-aerated water at a temperature of not to exceed 85 degrees Fahrenheit.

POMONA PUMPS
Fairbanks, Morse & Co.

Chicago 5,
 Illinois

Pomona
 California

LABORATORY PERFORMANCE
 PER STAGE 10" H. C. DEEP WELL TURBINE
 PUMP OPERATED AT 1160 R. P. M.
 FIELD LOSS MUST BE DEDUCTED