


CURVE NO. IOL3AD-2

Test No. 1499

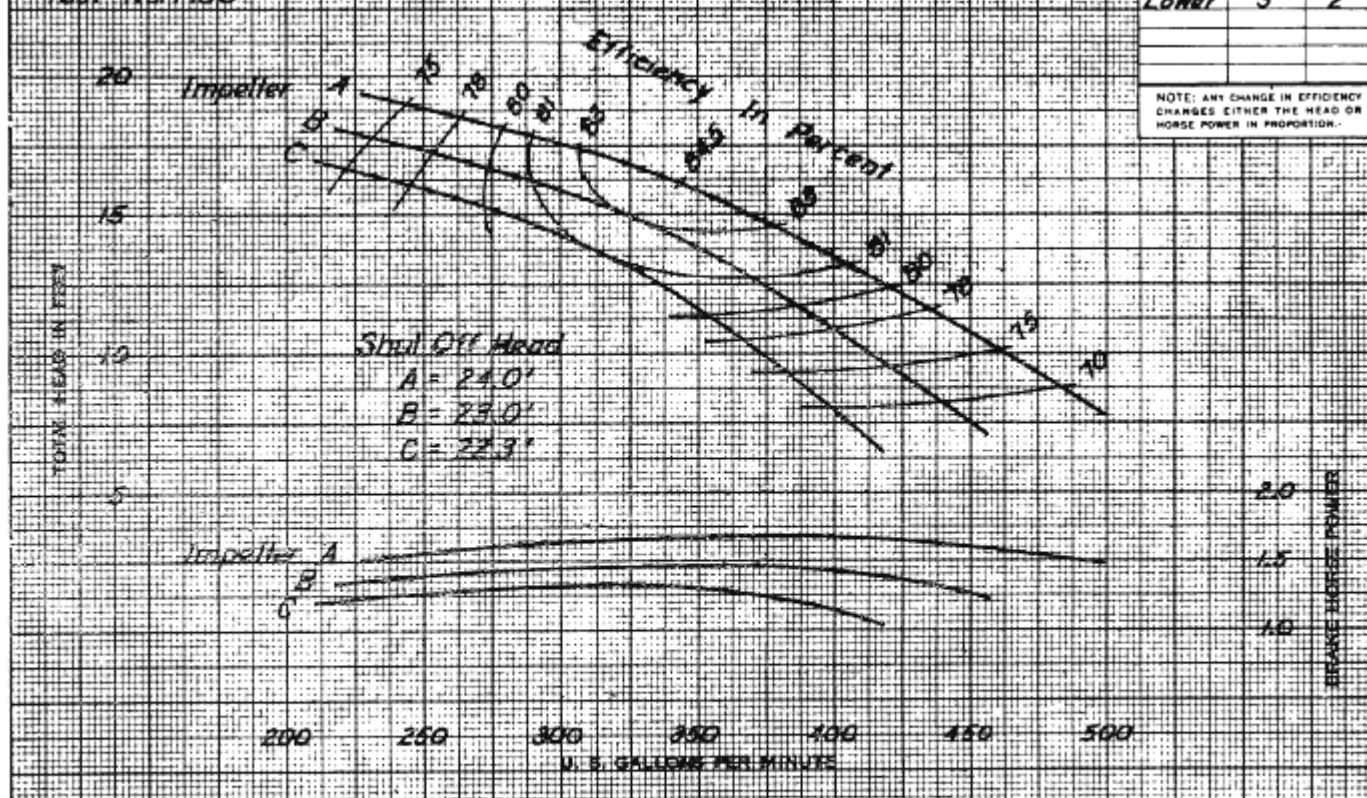

HYDRAULIC PERFORMANCE is contingent on the well furnishing the pump with the specified amount of clear, fresh, non-aerated water at a temperature of not to exceed 85 degrees Fahrenheit.

POMONA PUMPS
Fairbanks, Morse & Co.

Chicago 5,
 Illinois

Pomona
 California

LABORATORY PERFORMANCE **PE**
 PER STAGE **IOLC** DEEP WELL TURBINE
 PUMP OPERATED AT **1160** R. P. M.
 FIELD LOSS MUST BE DEDUCTED