


CURVE NO. 10XL 6AD-1

DEVELOPMENT PROJECT MFG

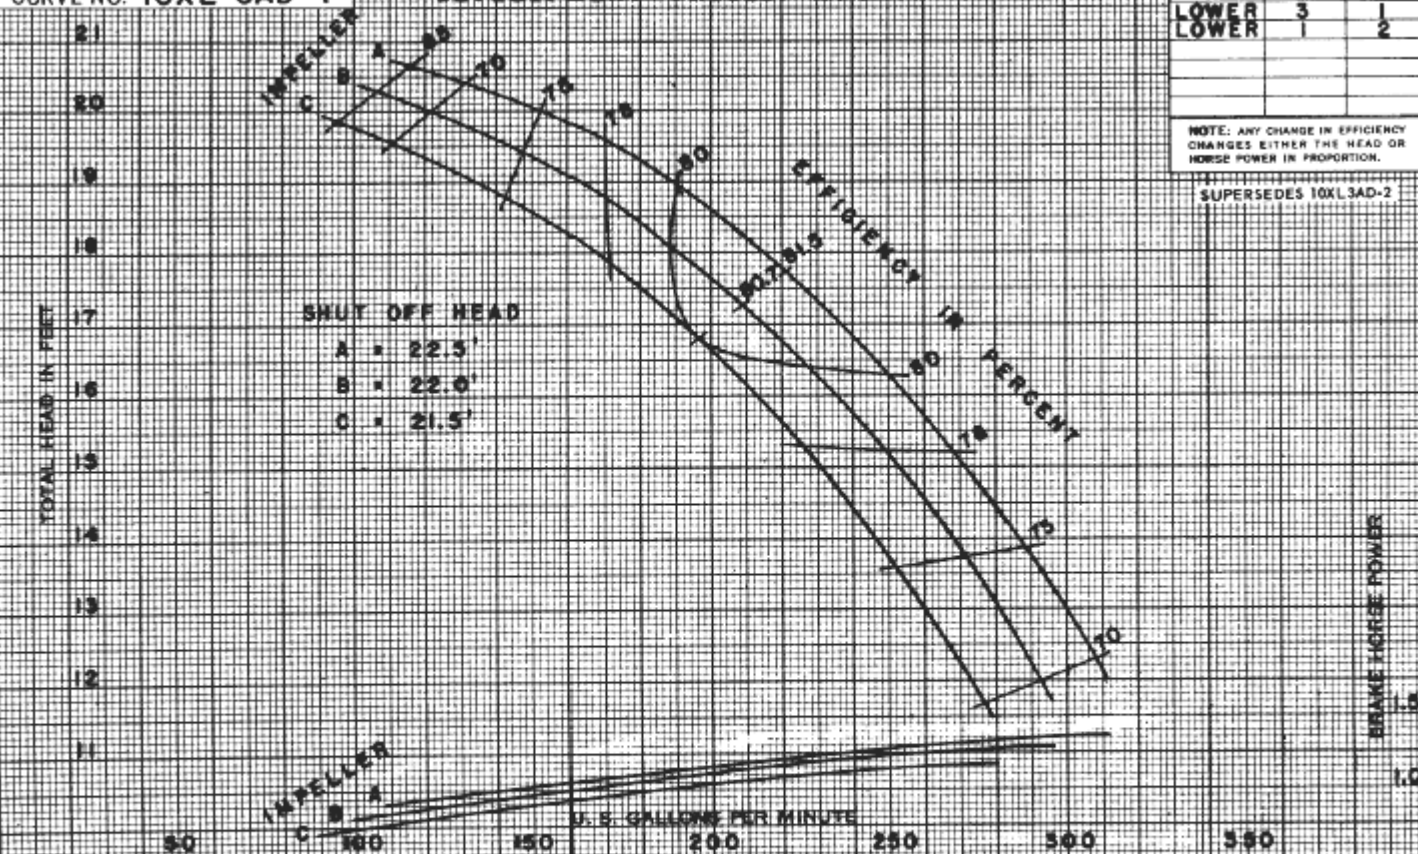

HYDRAULIC PERFORMANCE is contingent on the well furnishing the pump with the specified amount of clear, fresh, non-aerated water at a temperature of not to exceed 85 degrees Fahrenheit.

FAIRBANKS, MORSE & CO.

FAIRBANKS-MORSE BUILDING
CHICAGO 5, ILLINOIS

5-10-54

LABORATORY PERFORMANCE
PER STAGE 10" X.L.C. DEEP WELL TURBINE
PUMP OPERATED AT 1160 R. P. M.
FIELD LOSS MUST BE DEDUCTED