


CURVE NO. 10H3AF-1

Test No. 1267 & 1299

CHANGE EFFICIENCY AS FOLLOWS	NUMBER OF STAGES	FOR STAGES OF STAGES
LOWER	1	2
LOWER	5	1

NOTE: ANY CHANGE IN EFFICIENCY
CHANGES EITHER THE HEAD OR
HORSE POWER IN PROPORTION.

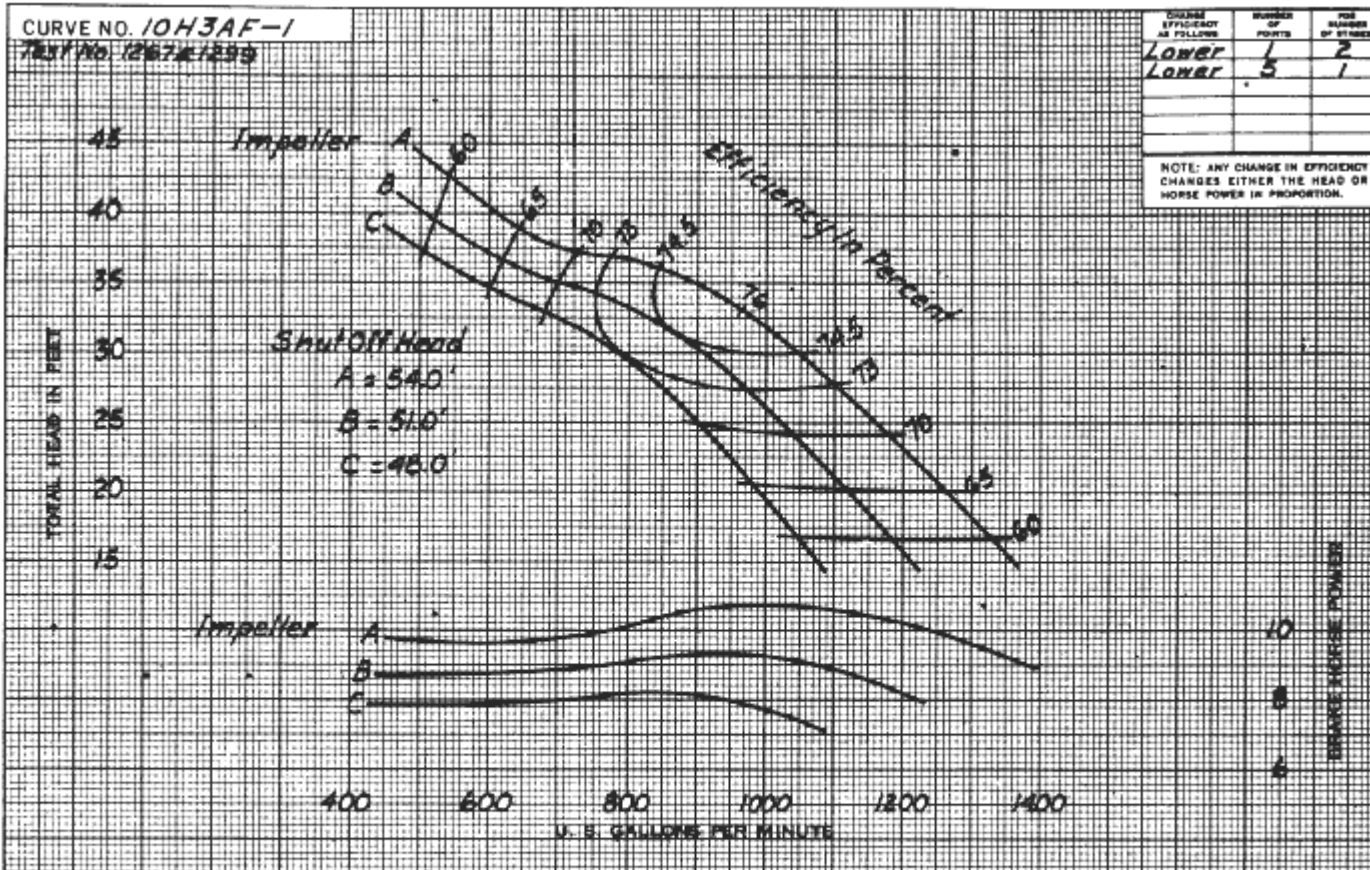

HYDRAULIC PERFORMANCE is contingent on the well furnishing the pump with the specified amount of clear, fresh, non-aerated water at a temperature of not to exceed 85 degrees Fahrenheit.

POMONA PUMPS
Fairbanks, Morse & Co.
Chicago 5, Illinois
Pomona California

LABORATORY PERFORMANCE
PER STAGE 10" H.C. DEEP WELL TURBINE
PUMP OPERATED AT 1760 R. P. M.
FIELD LOSS MUST BE DEDUCTED