


CURVE NO. 10XL 6AF-1

DEVELOPMENT PROJECT MFG

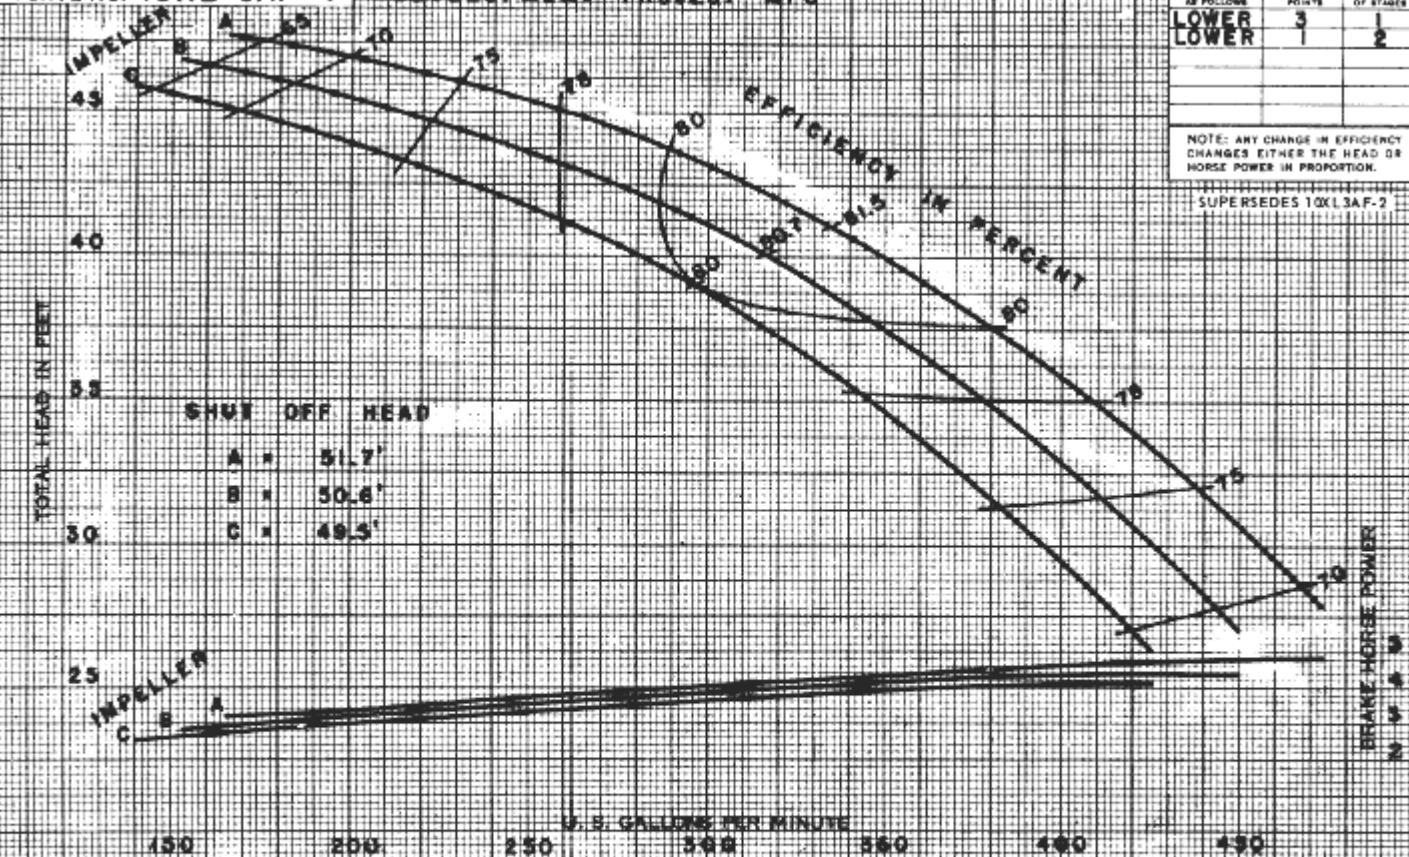

CHANGE EFFICIENCY AS FOLLOWS	NUMBER OF POINTS	FOR NUMBER OF STAGES
LOWER	3	1
LOWER	1	2

NOTE: ANY CHANGE IN EFFICIENCY
CHANGES EITHER THE HEAD OR
HORSE POWER IN PROPORTION.

SUPERSEDES 10XL 3AF-2

HYDRAULIC PERFORMANCE is contingent on the well furnishing the pump with the specified amount of clear, fresh, non-aerated water at a temperature of not to exceed 85 degrees Fahrenheit.

FAIRBANKS, MORSE & CO.

FAIRBANKS-MORSE BUILDING
CHICAGO 5, ILLINOIS

5-10-54

LABORATORY PERFORMANCE **PE**
PER STAGE **10"X.L.C.** DEEP WELL TURBINE
PUMP OPERATED AT **1760** R. P. M.
FIELD LOSS MUST BE DEDUCTED