


CURVE NO. 12H 6AF - 1

DEVELOPMENT PROJECT MF 6

SUPERSEDES 12H 6AF-1

CHANGE EFFICIENCY AS FOLLOWS	NUMBER OF POINTS	NEW NUMBER OF STAGES
LOWER	2	1
LOWER	1	2
NOTE: ANY CHANGE IN EFFICIENCY CHANGES EITHER THE HEAD OR HORSE POWER IN PROPORTION		

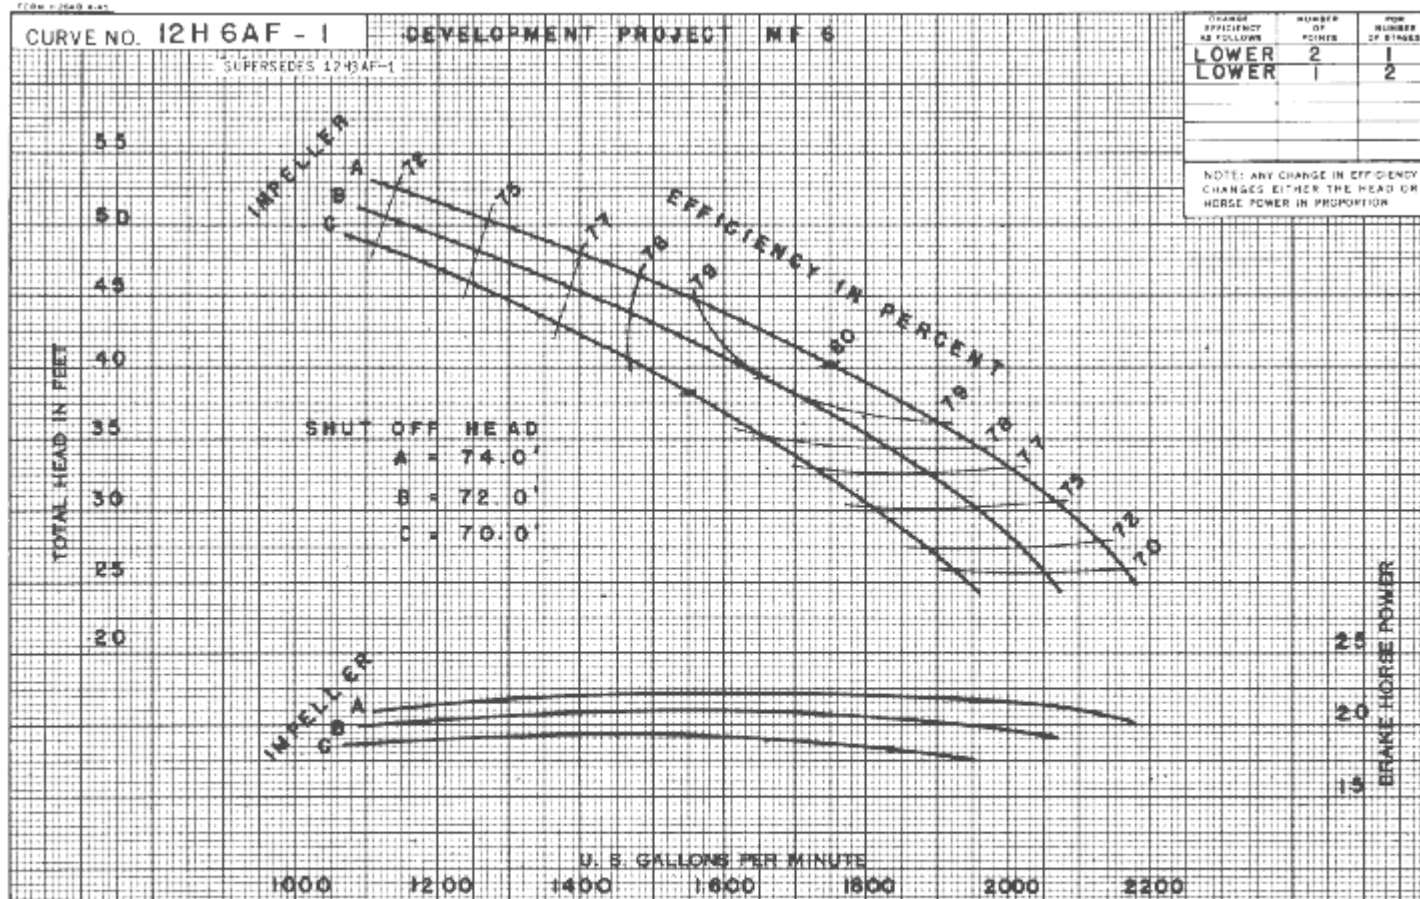

HYDRAULIC PERFORMANCE is contingent on the well furnishing the pump with the specified amount of clear, fresh, non-aerated water at a temperature of not to exceed 85 degrees Fahrenheit.

FAIRBANKS, MORSE & CO.
 POMONA WORKS
 POMONA • CALIFORNIA

1-3-51

LABORATORY PERFORMANCE
 PER STAGE 12" H.C. DEEP WELL TURBINE
 PUMP OPERATED AT 1760 R. P. M.
 FIELD LOSS MUST BE DEDUCTED