


CURVE NO. 6L3AF-3

TEST NO. 2651

CHANGE EFFICIENCY AS FOLLOWS	NUMBER OF POINTS	FOR NUMBER OF STAGES
LOWER	5	1
LOWER	3	2
LOWER	2	3

NOTE: ANY CHANGE IN EFFICIENCY
CHANGES EITHER THE HEAD OR
HORSE POWER IN PROPORTION.

Supersedes 6L3AF-2

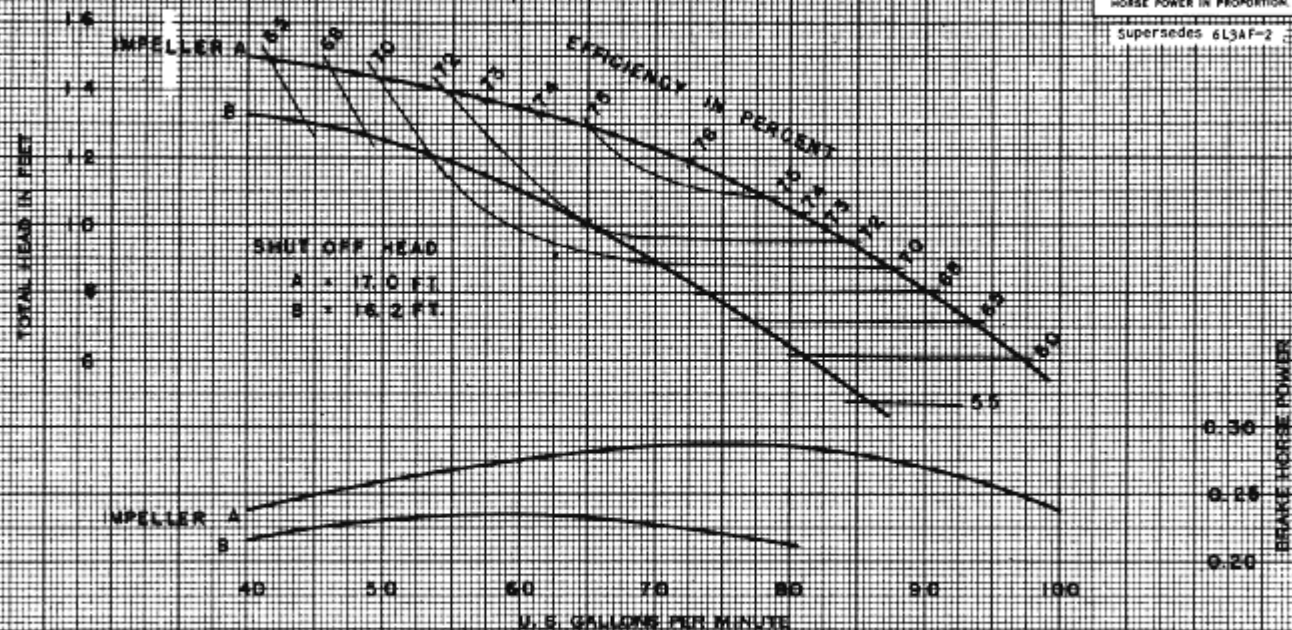

HYDRAULIC PERFORMANCE is contingent on the well furnishing the pump with the specified amount of clear, fresh, non-aerated water at a temperature of not to exceed 85 degrees Fahrenheit.

FAIRBANKS, MORSE & CO.

FAIRBANKS-MORSE BUILDING
CHICAGO 5, ILLINOIS

2-1-50

LABORATORY PERFORMANCE PL
PER STAGE 6LC DEEP WELL TURBINE
PUMP OPERATED AT 1760 R. P. M.
FIELD LOSS MUST BE DEDUCTED