


CURVE NO. 6XL4AF-2

TESTS ON P.O. NO. 59474 A B B

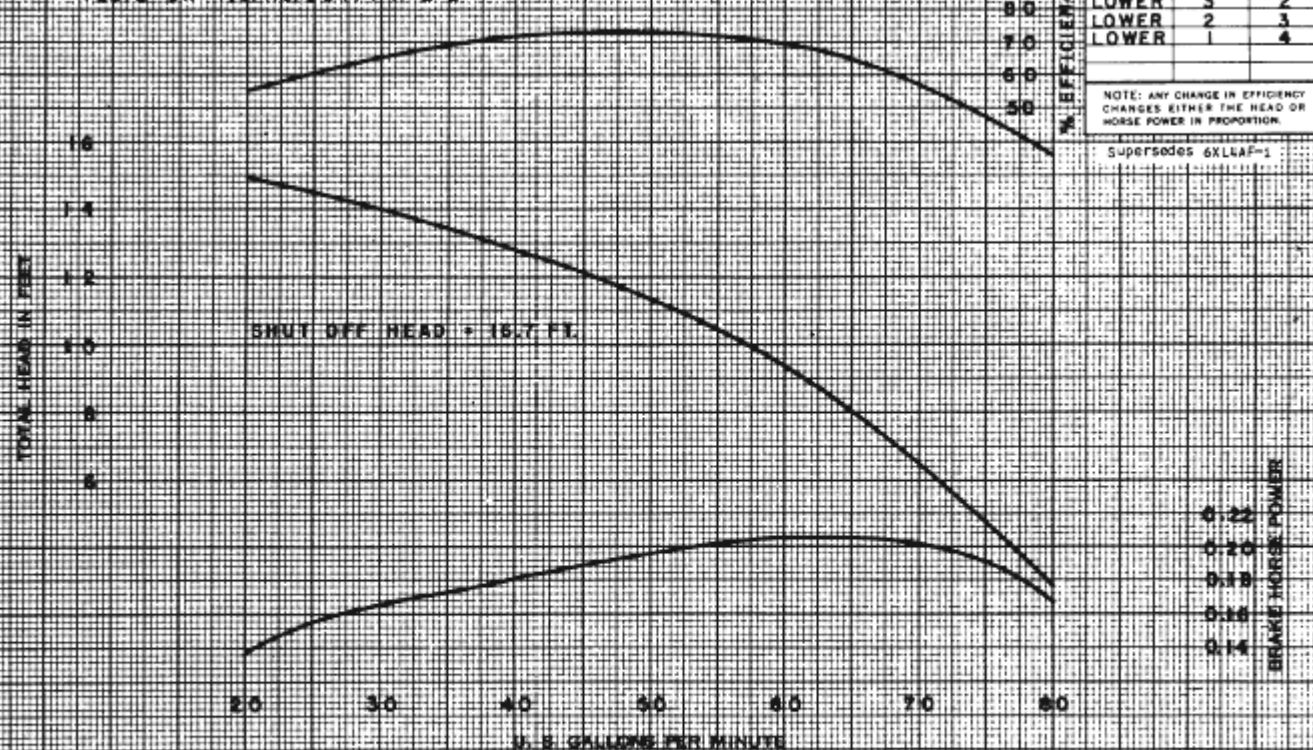

HYDRAULIC PERFORMANCE is contingent on the well furnishing the pump with the specified amount of clear, fresh, non-aerated water at a temperature of not to exceed 85 degrees Fahrenheit.

FAIRBANKS, MORSE & CO.

FAIRBANKS-MORSE BUILDING
CHICAGO 5, ILLINOIS

2-1-50

LABORATORY PERFORMANCE PL
PER STAGE 6XLC DEEP WELL TURBINE
PUMP OPERATED AT 1760 R. P. M.
FIELD LOSS MUST BE DEDUCTED