


FORM H-2000-6-48

CURVE NO. 10XL 6AL-1

DEVELOPMENT PROJECT NF6

CHANGE EFFICIENCY AS FOLLOWS	NUMBER OF POINTS	FOR NUMBER OF STAGES
LOWER	3	1
LOWER	1	2
NOTE: ANY CHANGE IN EFFICIENCY CHANGES EITHER THE HEAD OR HORSE POWER IN PROPORTION.		

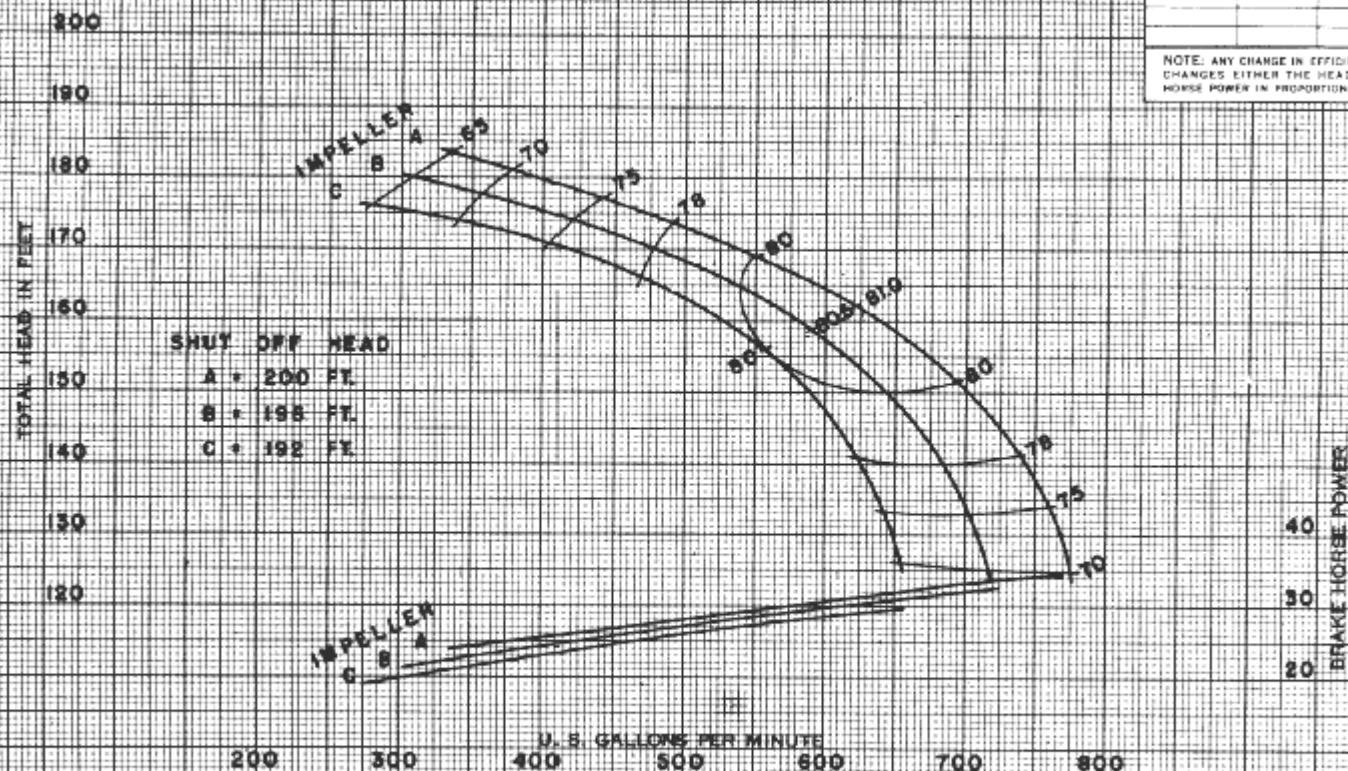

HYDRAULIC PERFORMANCE is contingent on the well furnishing the pump with the specified amount of clear, fresh, non-aerated water at a temperature of not to exceed 85 degrees Fahrenheit.

FAIRBANKS, MORSE & CO.

FAIRBANKS-MORSE BUILDING
CHICAGO 5, ILLINOIS

8-30-54

LABORATORY PERFORMANCE **P E**
 PER STAGE **10" X.L.C.** DEEP WELL TURBINE
 PUMP OPERATED AT **3500** R. P. M.
 FIELD LOSS MUST BE DEDUCTED