


CURVE NO. 6M 4AL -3

DEVELOPMENT PROJECT M.F. 6

Supersedes 6M4AL-1

CHANGE EFFICIENCY AS FOLLOWS	NUMBER OF POINTS	FOR NUMBER OF STAGES
LOWER	5	1
LOWER	3	2
LOWER	1	3
NOTE: ANY CHANGE IN EFFICIENCY CHANGES EITHER THE HEAD OR HORSE POWER IN PROPORTION.		

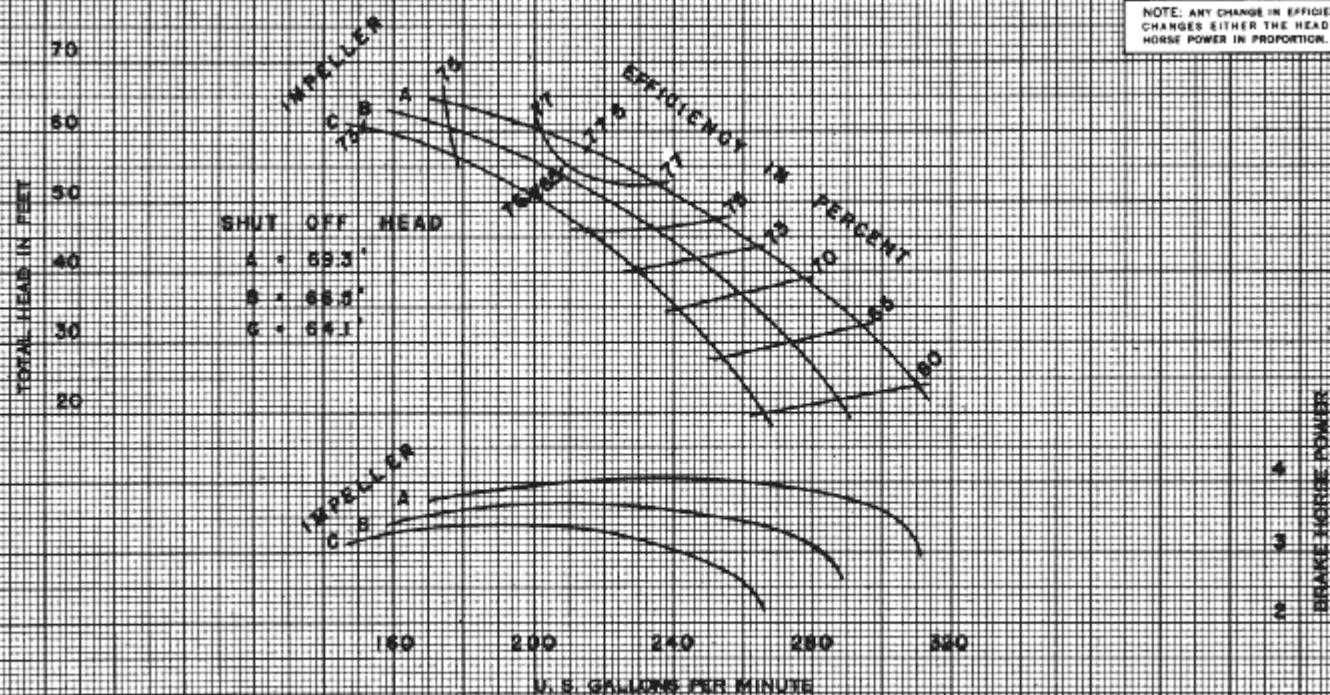

HYDRAULIC PERFORMANCE is contingent on the well furnishing the pump with the specified amount of clear, fresh, non-aerated water at a temperature of not to exceed 85 degrees Fahrenheit.

FAIRBANKS, MORSE & CO.
P O M O N A W O R K S
P O M O N A • C A L I F O R N I A

LABORATORY PERFORMANCE PL
PER STAGE 6" MC DEEP WELL TURBINE
PUMP OPERATED AT 3500 R. P. M.
FIELD LOSS MUST BE DEDUCTED
12-26-50