


CURVE NO. **8XL3AL-3** 4-1-53

DEVELOPMENT PROJECT MFB

TEST NOS. 3670 & 3870B

CHANGE EFFICIENCY AS FOLLOWS	NUMBER OF POINTS	FOR NUMBER OF STAGES
LOWER	5	1
"	2	2
NOTE: ANY CHANGE IN EFFICIENCY CHANGES EITHER THE HEAD OR HORSE POWER IN PROPORTION.		

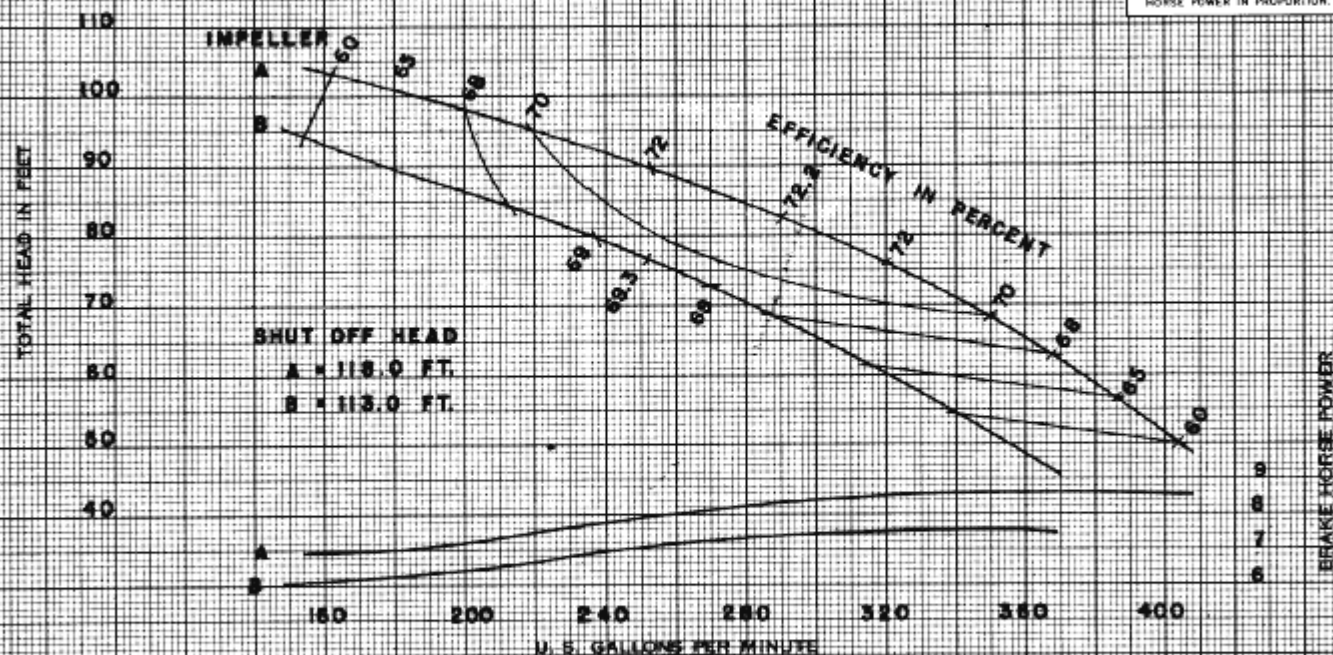

HYDRAULIC PERFORMANCE is contingent on the well furnishing the pump with the specified amount of clear, fresh, non-aerated water at a temperature of not to exceed 85 degrees Fahrenheit.

FAIRBANKS, MORSE & CO.

POMONA WORKS

POMONA • CALIFORNIA

LABORATORY PERFORMANCE **PE**
PER STAGE **8"XLC** DEEP WELL TURBINE
PUMP OPERATED AT **3500** R. P. M.
FIELD LOSS MUST BE DEDUCTED