


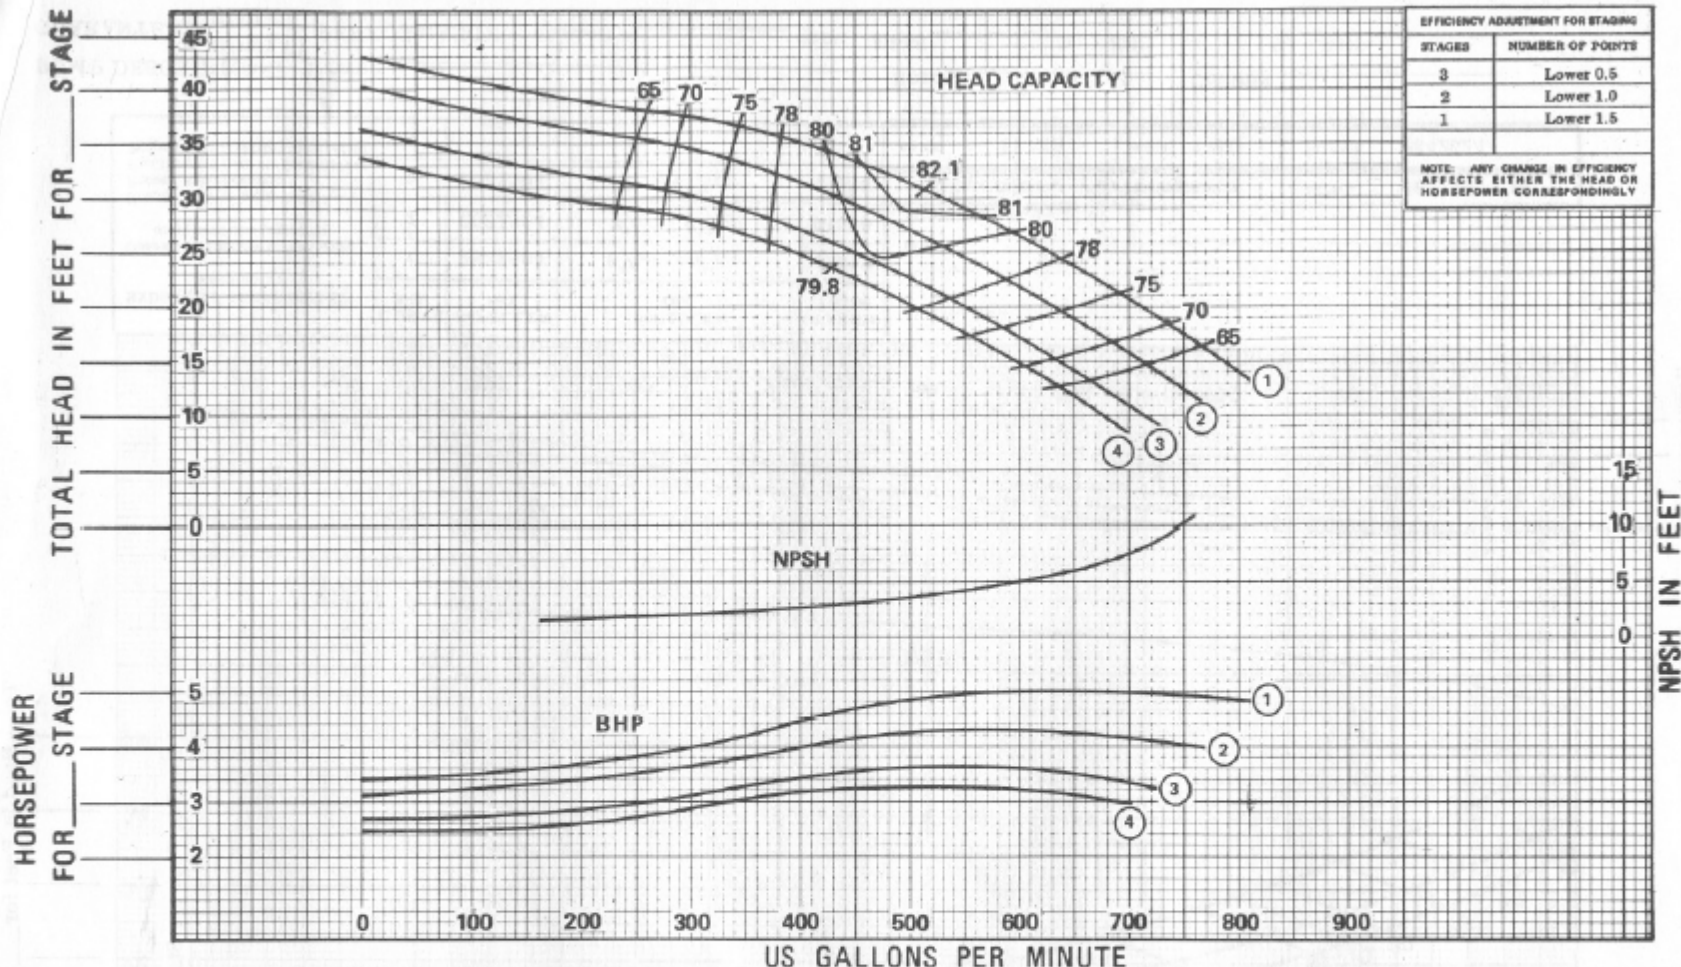

EFFICIENCY ADJUSTMENT FOR STAGING	
STAGES	NUMBER OF POINTS
3	Lower 0.5
2	Lower 1.0
1	Lower 1.5

NOTE: ANY CHANGE IN EFFICIENCY AFFECTS EITHER THE HEAD OR HORSEPOWER CORRESPONDINGLY

HYDRAULIC PERFORMANCE WARRANTY Guaranteed at designated point only, and contingent on: Proper flow to pump suction Proper submergence Fluid free of gas, air & abrasives Proper lateral setting of impeller	CURVE NO.	IMPELLER NO.	IMPELLER DIA.	TAKEN FROM	Customer _____
	1	2649365	FULL DIA. 8.93 x 9.71	56890	Item _____
	2	2649365	8.62 x 9.44	57558	Peerless Ref. No: _____
	3	2649365	8.25 x 9.16	57586	Laboratory Performance SIZE 12LD RPM 1160 BOWL 2634907 CIE CURVE 4806200
	4	2649365	7.88 x 8.91	57666	

PUMP DESCRIPTION: Driver _____; Head _____; Column _____

GUARANTEED ☐ BOWL ☐ FIELD ☐ PERFORMANCE: Capacity _____ gpm; Head _____ ft; Eff _____ %; BHP _____