


BOWL V665D



HYDRAULIC PERFORMANCE GUARANTEED AT THE DESIGNATED POINT ONLY AND IS CONTINGENT ON WELL PROPERLY FURNISHING PUMP WITH NON-AERATED OR NON- GASEOUS WATER FREE FROM AB- RASIVES. PUMP BOWLS MUST BE PROPERLY ADJUSTED FOR THE HEAD AT WHICH THEY OPERATE AND MUST BE SUBMERGED.	CURVE NO.	IMPELLER NO.	IMPELLER DIA.	TAKEN FROM	PEERLESS PUMP DIVISION FOOD MACHINERY CORPORATION LOS ANGELES 31, CALIF. 	PERFORMANCE PER STAGE	
	1	V644C	10-3/16"	4932		14"LA	DEEP WELL
	2	V645C	10-3/16"	4817		1160	TURBINE PUMP
	3						R. P. M.
						SHEET NO.	R-1316

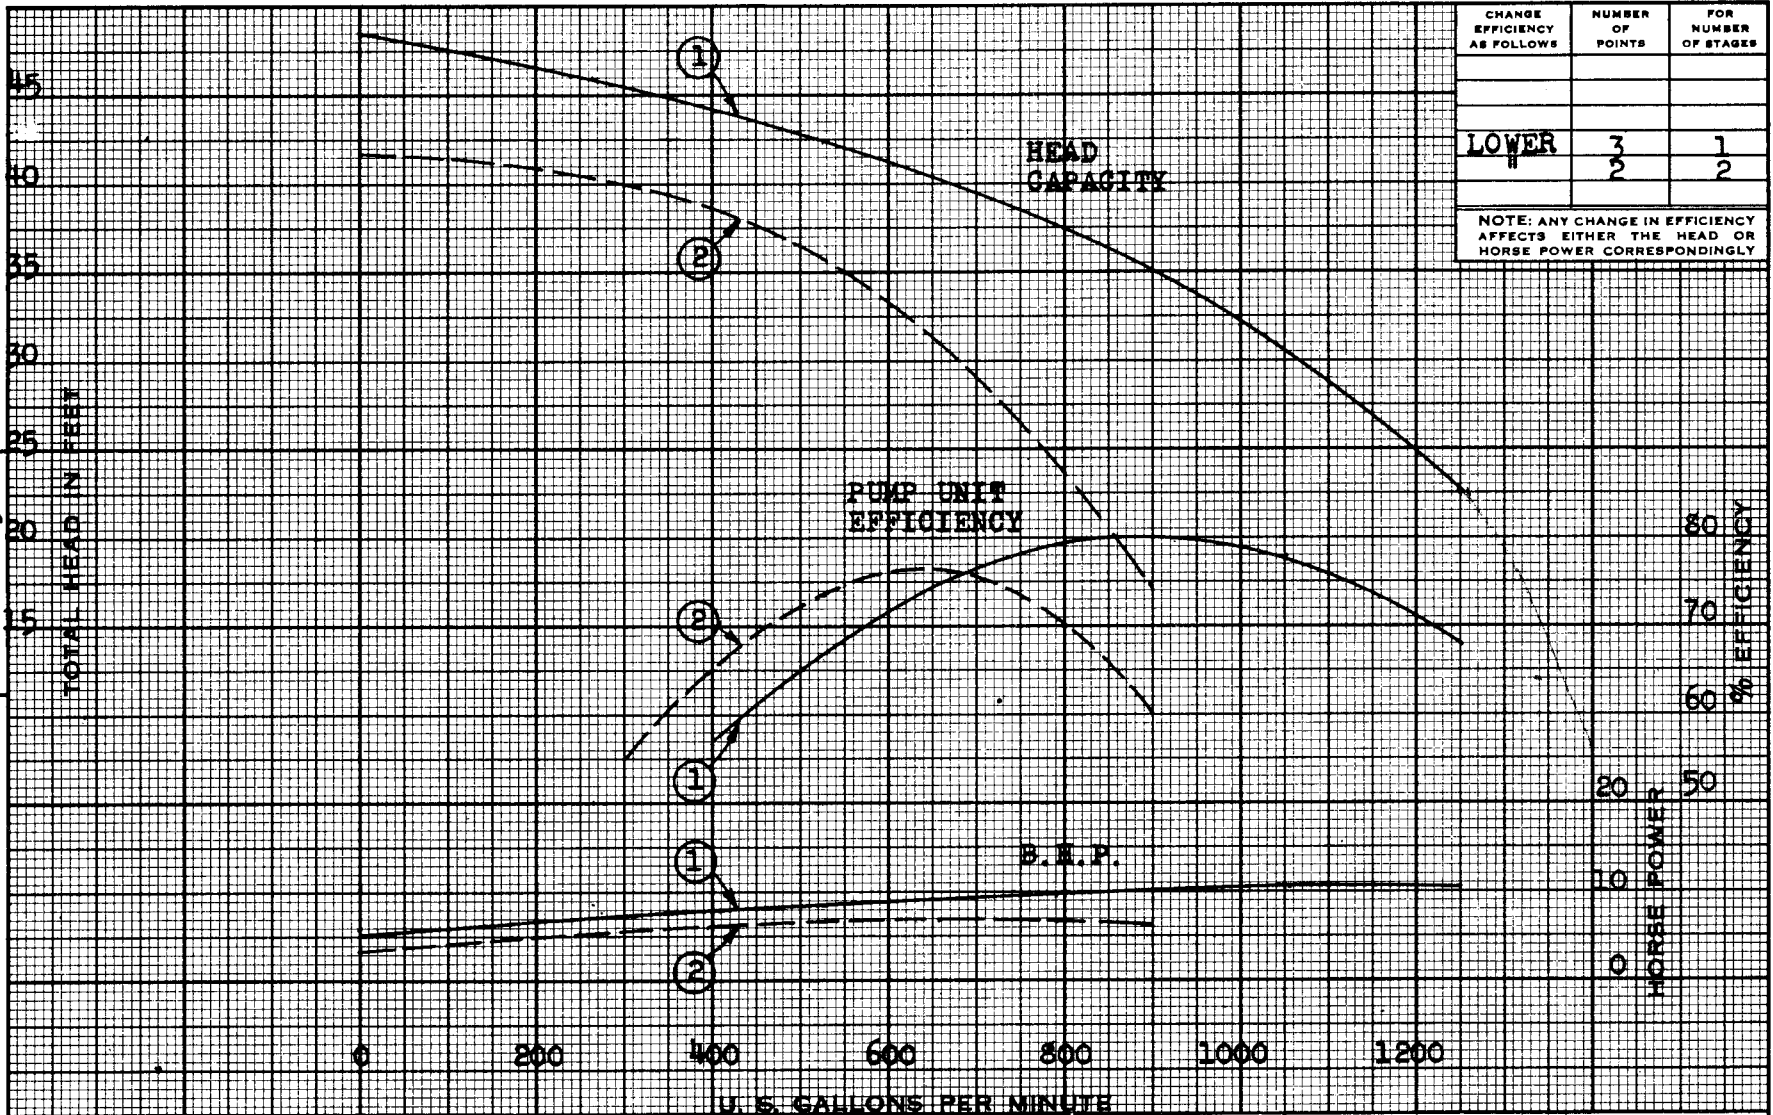