


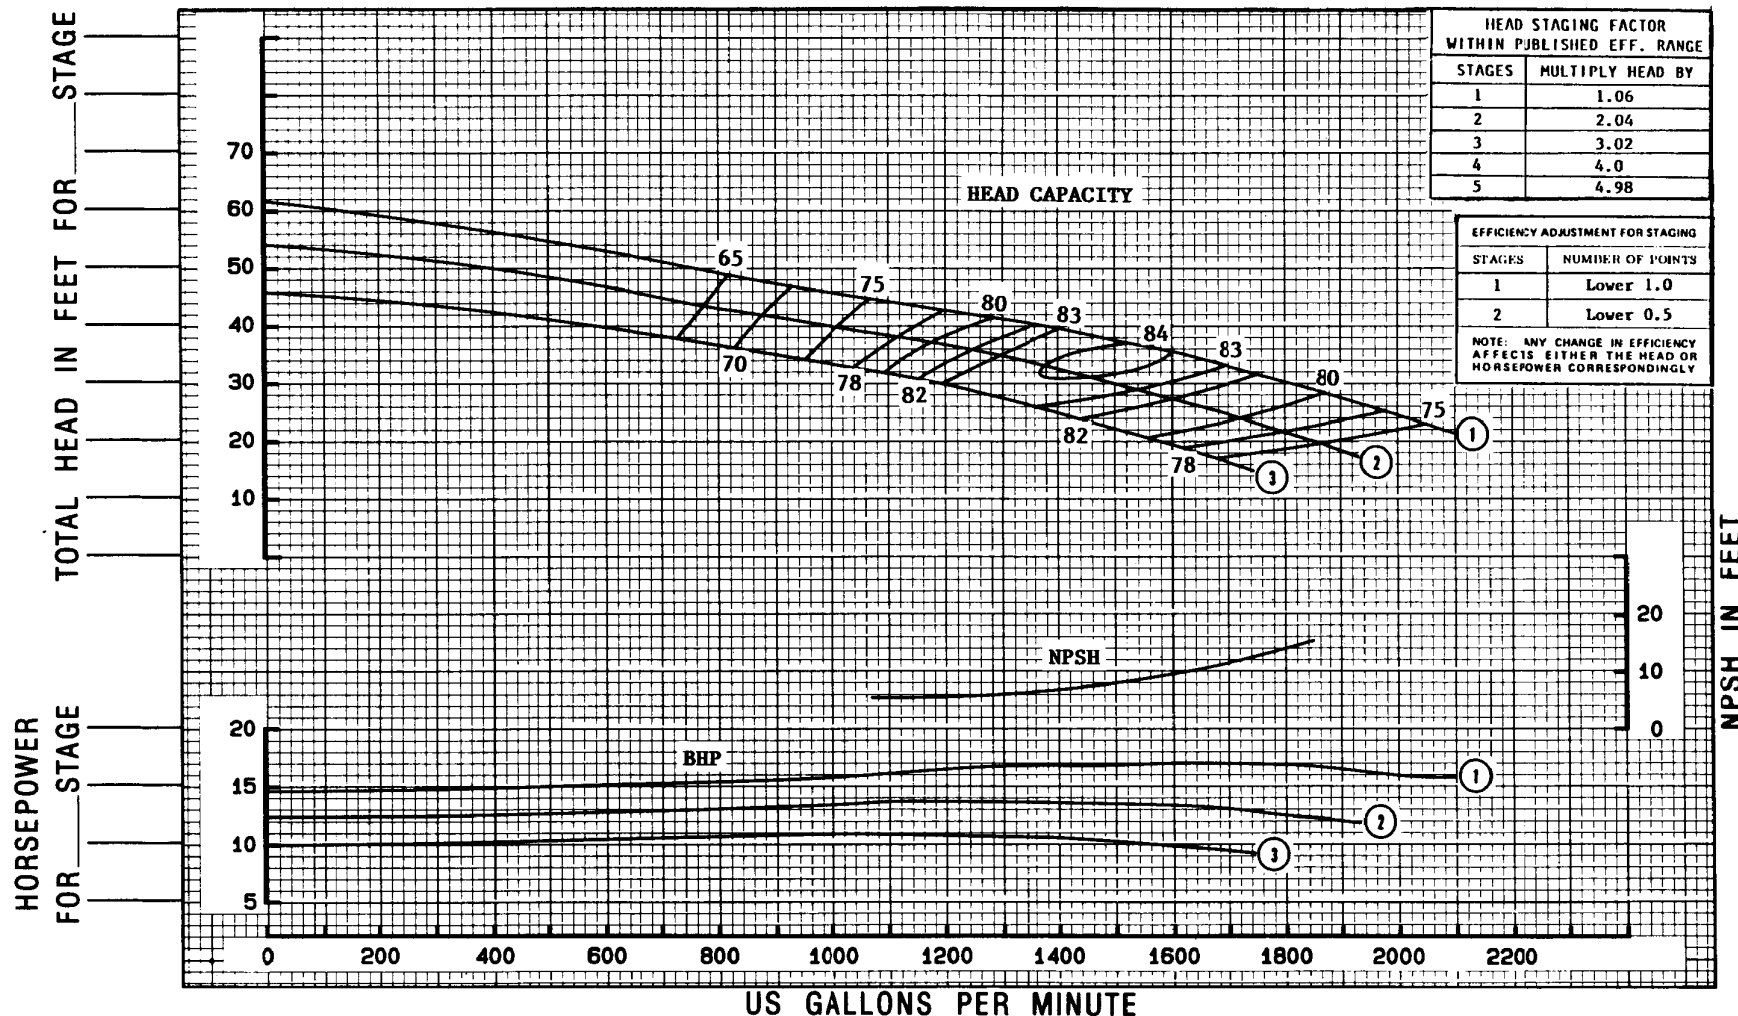

Head and Capacity Warranty Contingent on: Proper flow to pump suction Proper submergence Fluid free of gas, air & abrasives Proper lateral setting of impeller	CURVE NO.	IMPELLER NO.	IMPELLER DIA.	TAKEN FROM	Customer _____		
	1	4602279	9.75 x 11.62	63743	Item _____		
	2	4602279	9.41 x 11.25	63876	Peerless Ref. No: _____		
	3	4602279	8.81 x 10.62	63923	Laboratory Performance		BOWL 4602248 CIE
	4				SIZE 14MD	RPM 1180	CURVE 4806410

PUMP DESCRIPTION: Driver _____; Head _____; Column _____
 BOWL ☐ PERFORMANCE: Capacity _____ gpm; Head _____ ft; Eff _____ %; BHP _____
 FIELD ☐