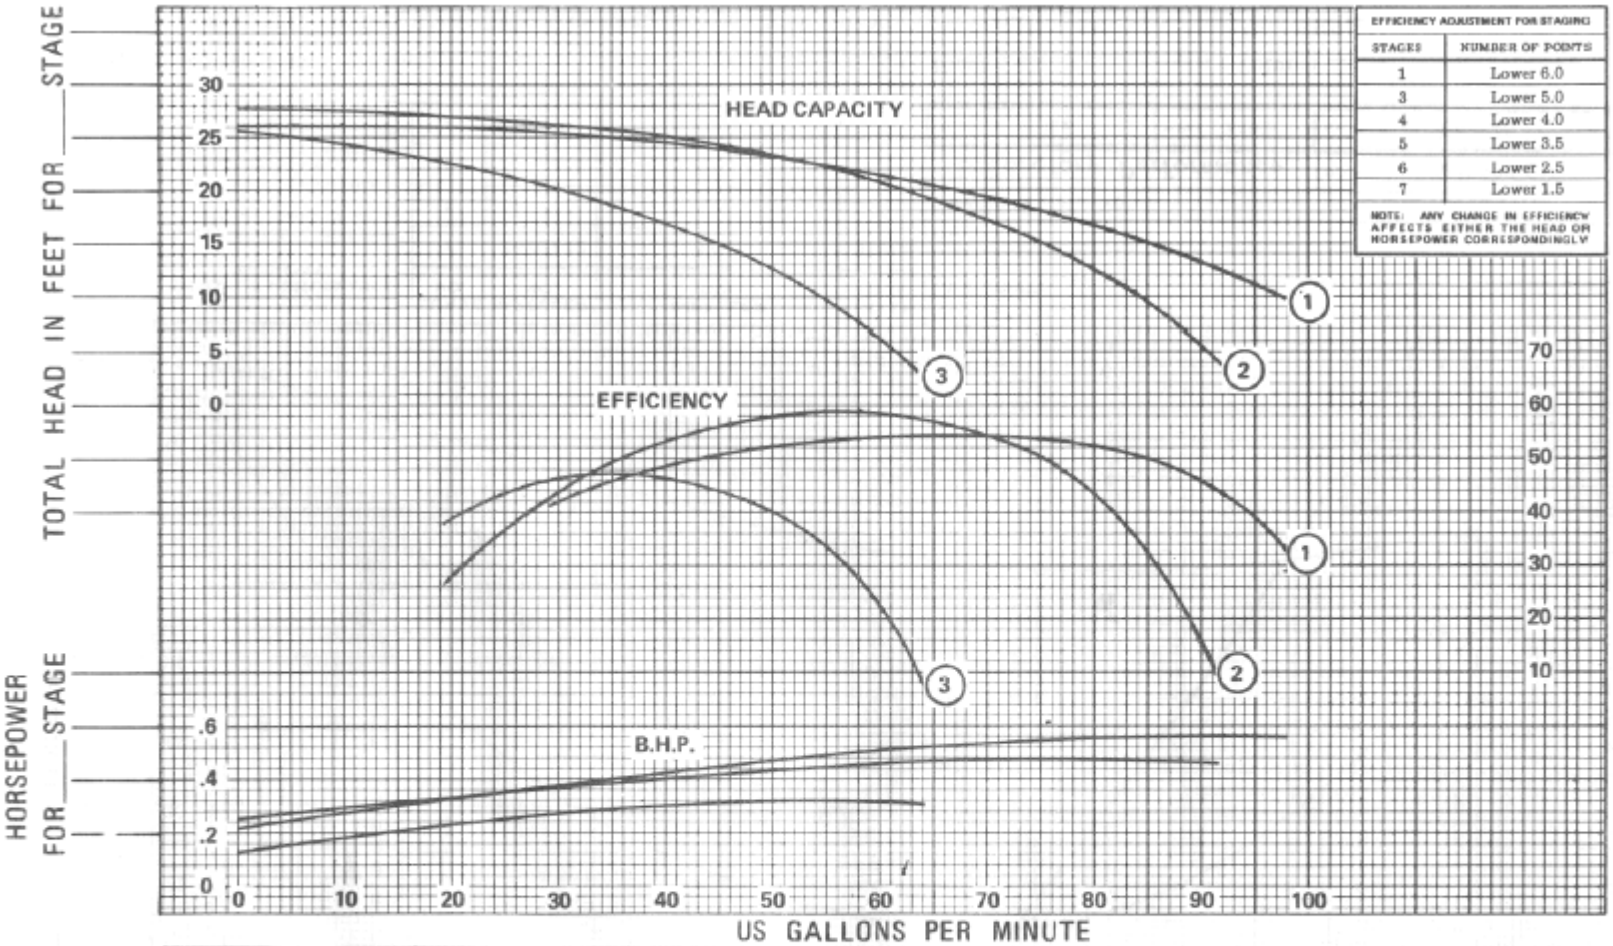


EFFICIENCY ADJUSTMENT FOR STAGING	
STAGES	NUMBER OF POINTS
1	Lower 6.0
3	Lower 5.0
4	Lower 4.0
5	Lower 3.5
6	Lower 2.5
7	Lower 1.5

NOTE: ANY CHANGE IN EFFICIENCY AFFECTS EITHER THE HEAD OR HORSEPOWER CORRESPONDINGLY

HYDRAULIC PERFORMANCE WARRANTY	CURVE NO.	IMPELLER NO.	IMPELLER DIA.	TAKEN FROM
Guaranteed at designated point only, and contingent on: Proper flow to pump suction, Proper submergence, Fluid free of gas, air & abrasives, Proper lateral setting of impeller	1	2621671	3-9/64"	55071
	2	2621672	3-9/64"	55430
	3	2621673	3-9/64"	55437
	4			

Customer _____

Item _____

Peerless Ref. No: _____

Laboratory Performance BOWL V3019 CIE

SIZE 4LO RPM 3460 CURVE 4806056

PUMP DESCRIPTION: Driver _____; Head _____; Column _____

GUARANTEED BOWL ☐ FIELD ☐ PERFORMANCE: Capacity _____ gpm; Head _____ ft; Eff _____ %; BHP _____