

2 POLE 60 HERTZ PERFORMANCE

GUARANTEED PERFORMANCE

☐ Bowl

☐ Field

Capacity _____ gpm

Head _____ Feet


BHP _____

EFFICIENCY _____ %

DRIVER _____

HEAD _____

COLUMN _____

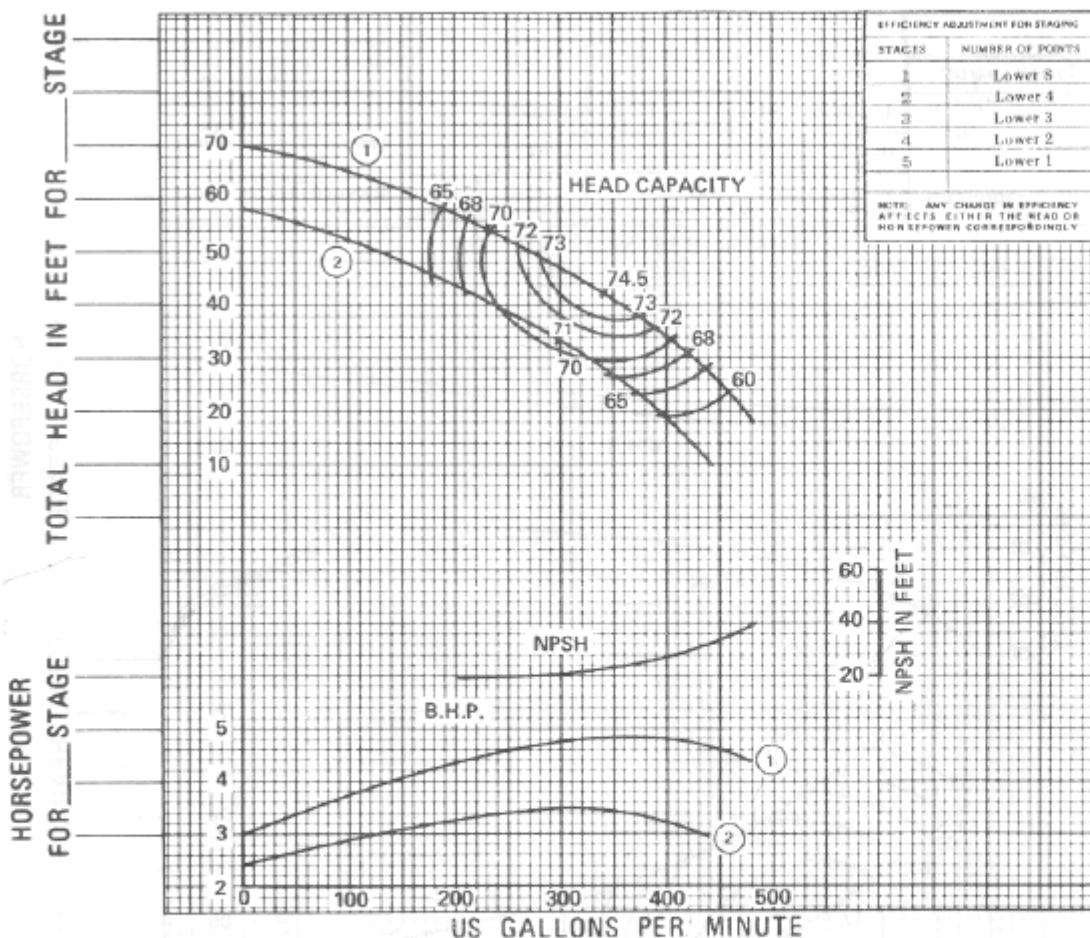

EFFICIENCY ADJUSTMENT FOR STAGING	
STAGES	NUMBER OF POINTS
1	Lower 8
2	Lower 4
3	Lower 3
4	Lower 2
5	Lower 1

NOTE: ANY CHANGE IN EFFICIENCY AFFECTS EITHER THE HEAD OR HORSEPOWER CORRESPONDINGLY

HYDRAULIC PERFORMANCE WARRANTY					Customer _____		
Guaranteed at designated point only, and contingent on: Proper flow to pump suction Proper submergence Fluid free of gas, air & abrasives Proper lateral setting of impeller	CURVE NO.	IMPELLER NO.	IMPELLER DIA.	TAKEN FROM	Item _____		
	1	2607800	3-29/32 x 4-1/2	55429	Peerless Ref. No: _____		
	2	2607800	3-23/32 x 4-9/32	55538	Laboratory Performance		
	3				SIZE 6HXB	RPM 3460	CURVE 4806263

BOWL 2607803 CIE