

2 POLE 60 HERTZ PERFORMANCE

GUARANTEED PERFORMANCE

○ Bowl
○ Field

Capacity _____ gpm

Head _____ Feet


BHP _____

EFFICIENCY _____ %

DRIVER _____

HEAD _____

COLUMN _____

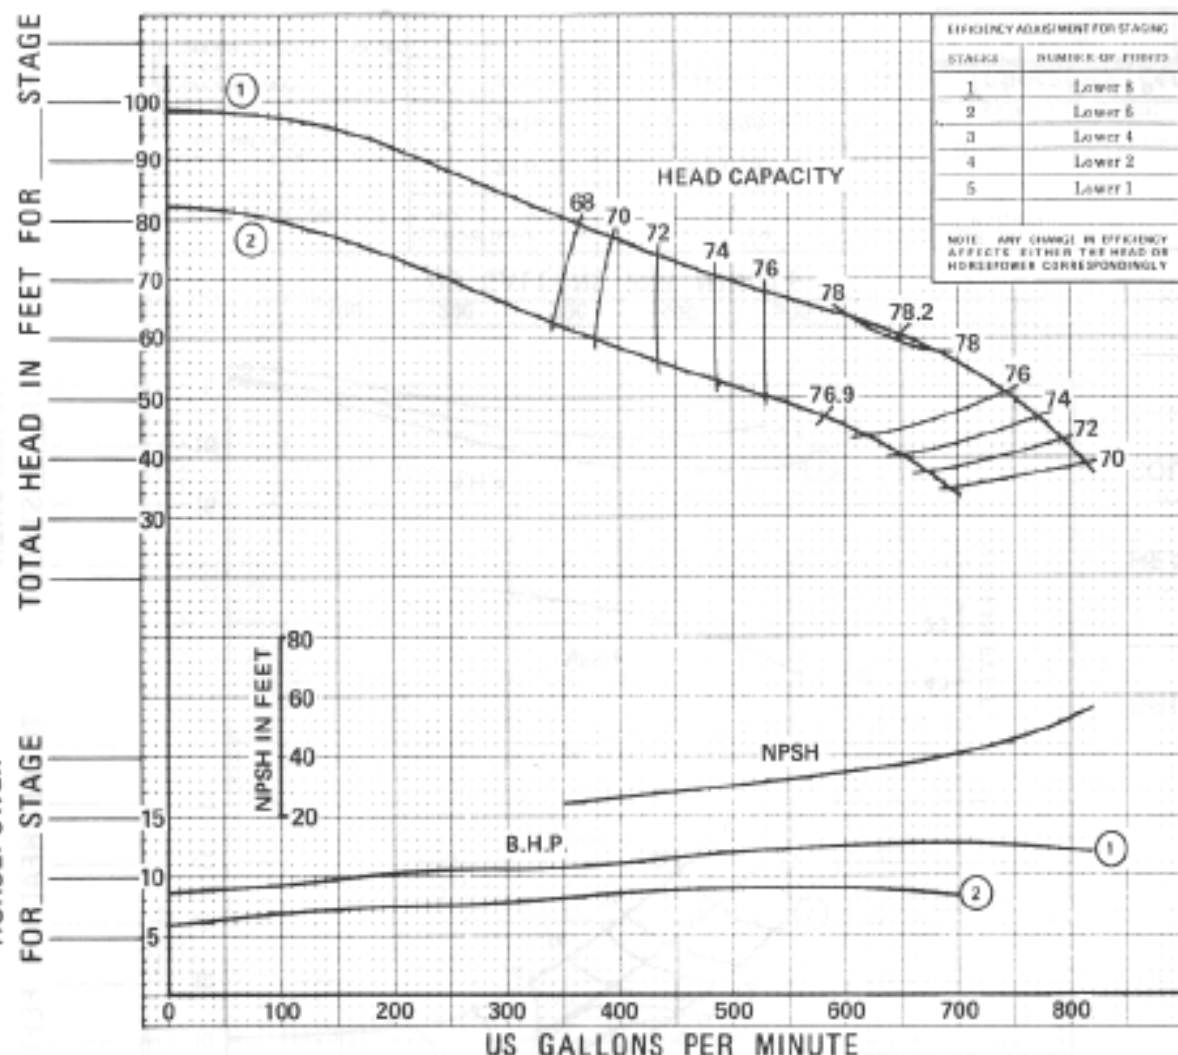

EFFICIENCY ASSIGNMENT FOR STAGING	
STAGES	NUMBER OF STAGES
1	Lower 8
2	Lower 6
3	Lower 4
4	Lower 2
5	Lower 1

NOTE: ANY CHANGE IN EFFICIENCY AFFECTS EITHER THE HEAD OR HORSEPOWER CORRESPONDINGLY

HYDRAULIC PERFORMANCE WARRANTY	CURVE NO.	IMPELLER NO.	IMPELLER DIA.	TAKEN FROM	Customer _____		
	1	2607921	4-19/32" x 5-11/32"	55541	Item _____		
	2	2607921	4-11/32" x 5-3/32"	55622	Peerless Ref. No: _____		
	3				Laboratory Performance		
	4				SIZE 7HXB	RPM 3460	CURVE 4806267
Guaranteed at designated point only, and contingent on: Proper flow to pump section Proper submergence Fluid free of gas, air & abrasives Proper lateral setting of impeller					BOWL 2607951 CIE		