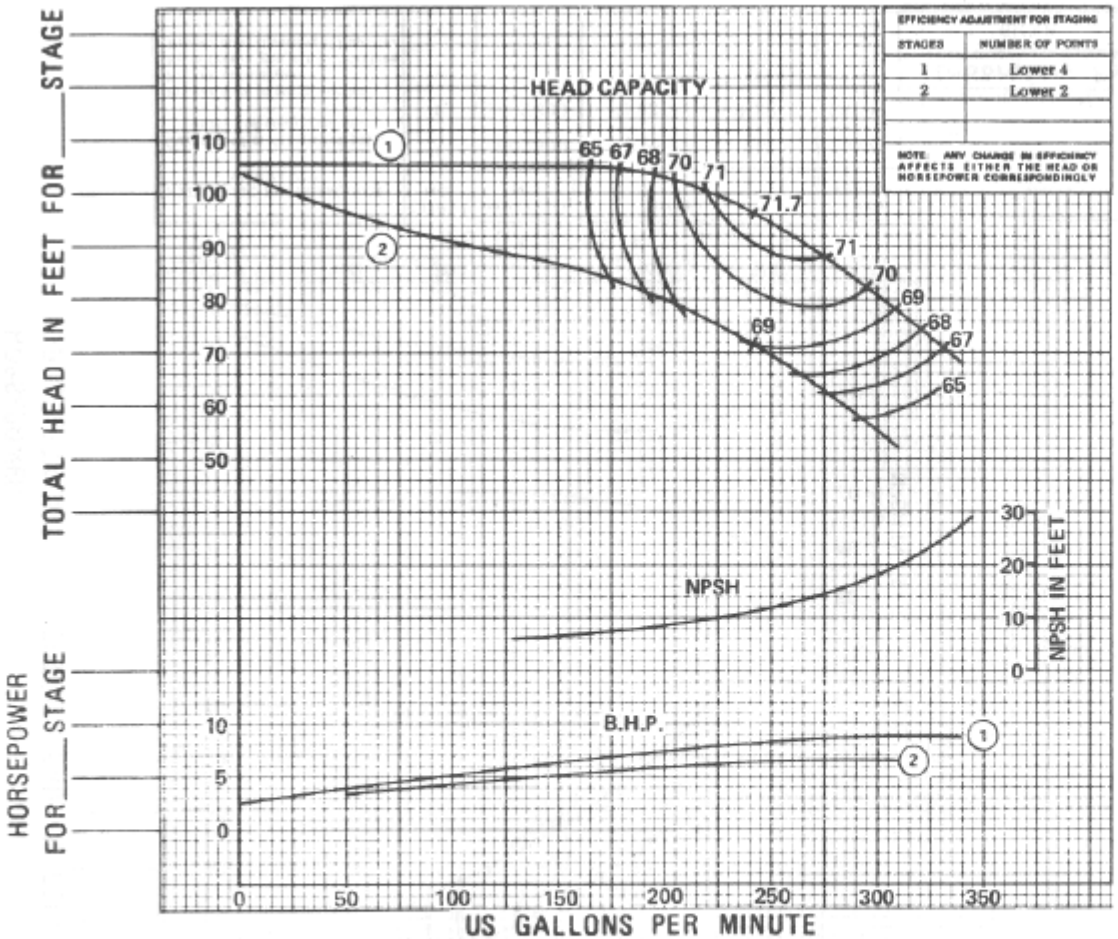


EFFICIENCY ADJUSTMENT FOR STAGING	
STAGES	NUMBER OF POINTS
1	Lower 4
2	Lower 2

NOTE: ANY CHANGE IN EFFICIENCY AFFECTS EITHER THE HEAD OR HORSEPOWER CORRESPONDINGLY

2 POLE 60 HERTZ PERFORMANCE

GUARANTEED PERFORMANCE

◯ Bowl
◯ Field

Capacity _____ gpm

Head _____ Feet

BHP _____

EFFICIENCY _____ %

DRIVER

_____

_____

HEAD

_____

COLUMN

_____

_____

_____

HYDRAULIC PERFORMANCE WARRANTY

Guaranteed at designated point only, and contingent on:

Proper flow to pump suction
Proper submergence
Fluid free of gas, air & abrasives
Proper lateral setting of impeller

CURVE NO.	IMPELLER NO.	IMPELLER DIA.	TAKEN FROM
1	2626207	5-5/16	55750
2	2626207	4-5/8 x 5-5/16	55741
3			
4			

Customer _____

Item _____

Peerless Ref. No:

Laboratory Performance BOWL 2626187 CIE

SIZE 7LB RPM 3460 CURVE 4806264