


SECTION 201
PAGE 6
DATE 7/1/99
SUPERCEDES All Previous

SG6C


3450 R.P.M.

SIMFLO
PUMPS

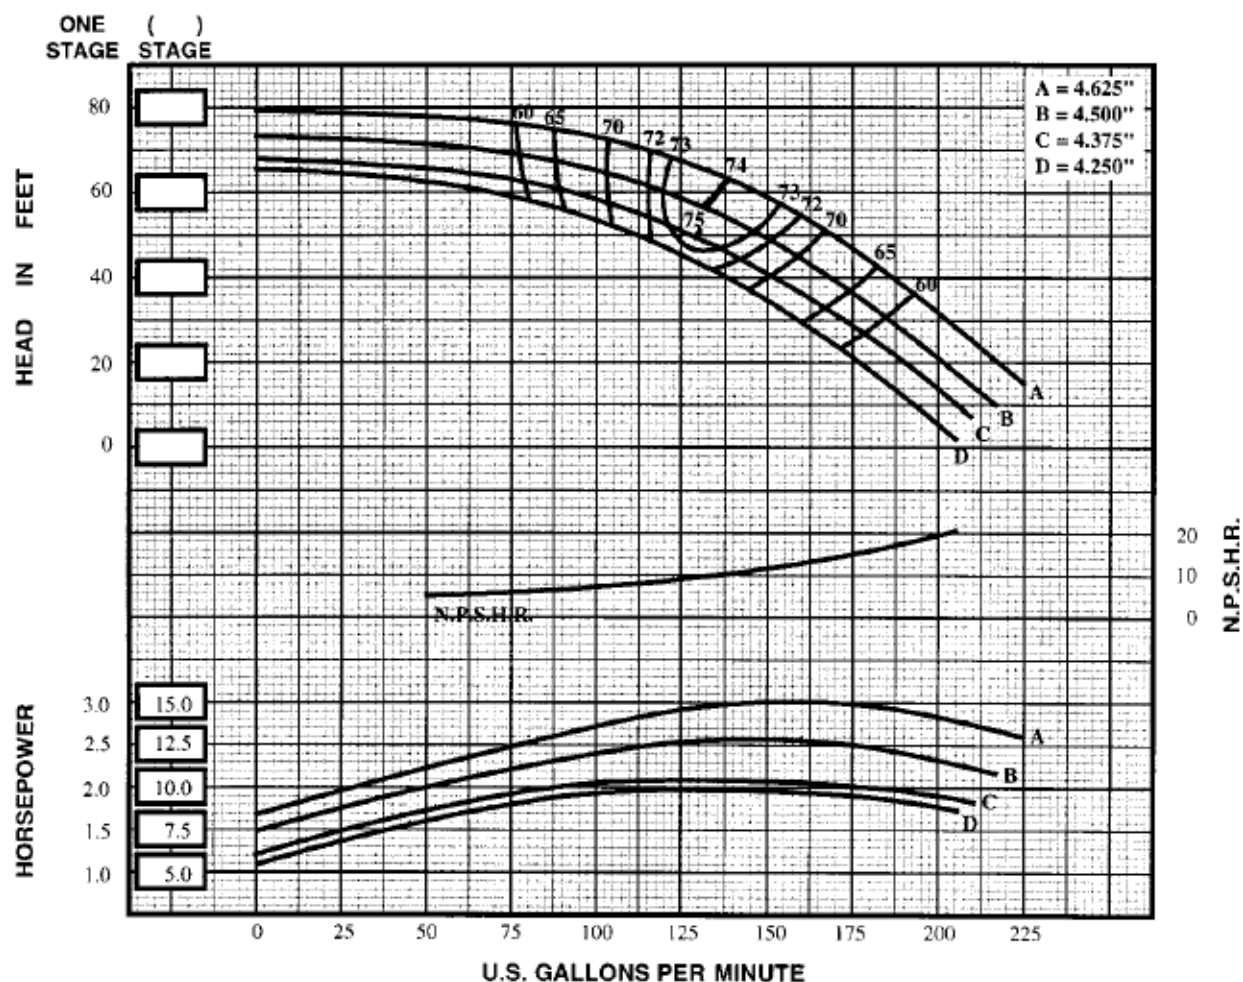


IMPELLER TYPE = ENCLOSED	STD. SHAFT DIA. = 1.000"	NO. STAGES	EFF. CHANGE	MATERIAL	B.E.P. EFF. CHANGE
IMPELLER NO. = SH6L	MAX. SHAFT DIA. = 1.000"				
IMPELLER WT. - LBS. = 2.6	STD. LATERAL = .625"	1	-4	IMP. - C.I.	-3
ONE STAGE WT. - LBS. = 55.0	DISCHARGE SIZES = 3", 4"	2	-3	IMP. - NI-RI	-2
ADD'L STAGE WT. - LBS. = 18.5	SUCTION SIZES = 4"	3	-2	IMP. - S.S.	-4
MAX. SPHERE SIZE = .281"	ONE STAGE WR ² = .033	4	-1	BOWL - BRZ.	-3
MIN. SUBMERGENCE* = 11"	K-FACTOR, MAX = 2.30	5	0	BOWL - NI-RI	-1
				BOWL - S.S.	-4

Δ CONSULT FACTORY

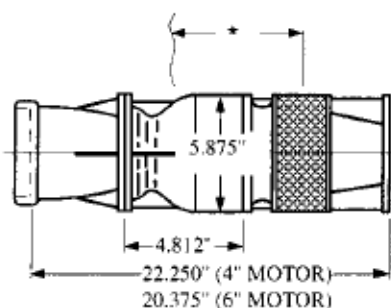

SUBMERSIBLE TURBINE

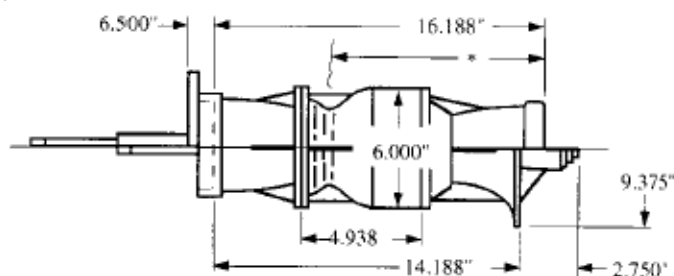

LINESHAFT TURBINE