


SECTION 201
PAGE 5.2
DATE 7/1/99
SUPERCEDES All Previous

SP5C


3450 R.P.M.

SIMFLO
PUMPS

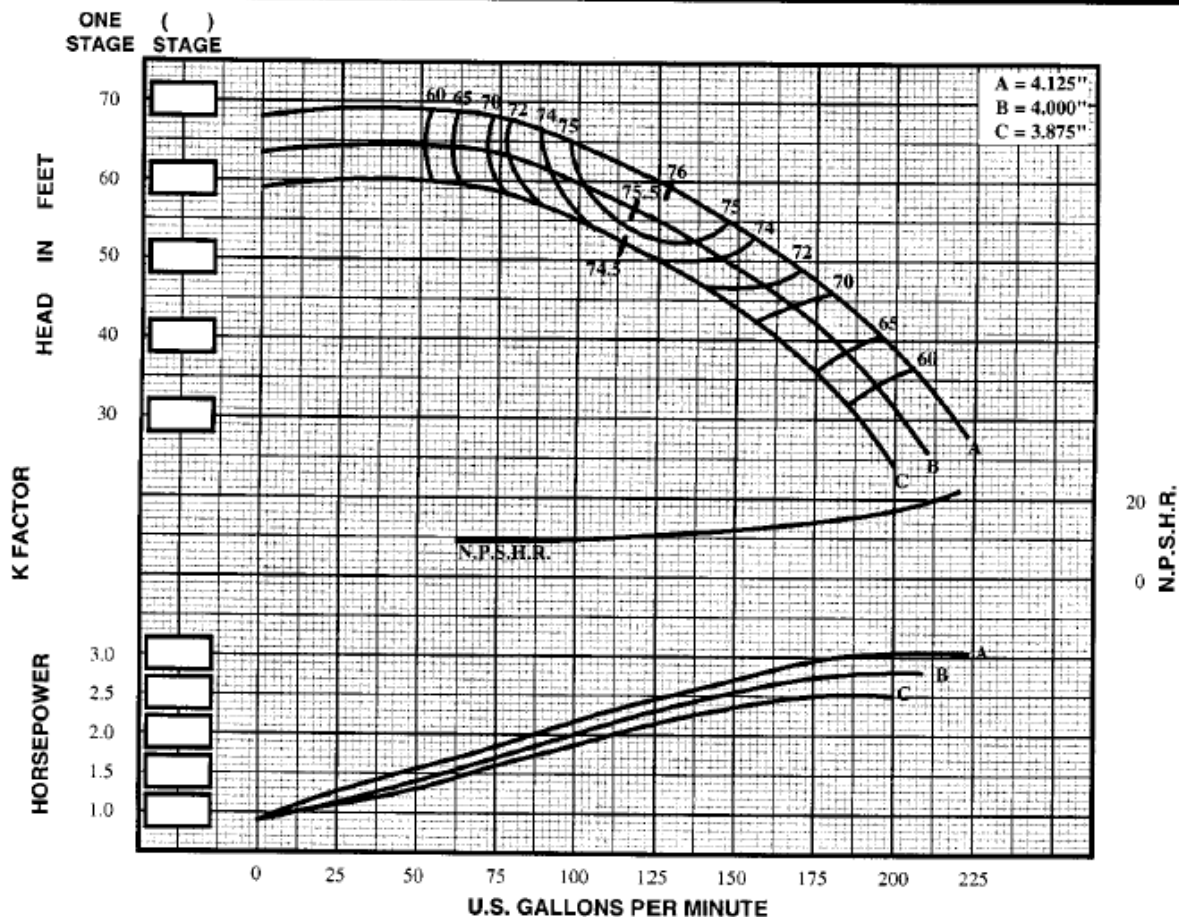

IMPELLER TYPE = enclosed	STD. SHAFT DIA. = .875"	NO. STAGES	EFF. CHANGE	MATERIAL	B.E.P. EFF. CHANGE
IMPELLER NO. = SS5L	MAX. SHAFT DIA. = .875"	1	-4	IMP. - C.I.	-4
IMPELLER WT. - LBS. = 1.75	STD. LATERAL = .075"	2	-3	IMP. - NI-RI	-3
ONE STAGE WT. - LBS. = 50	DISCHARGE SIZES = 3" - 4"	3	-2	IMP. - S.S.	-6
ADD'L STAGE WT. - LBS. = 14	SUCTION SIZES = 4"	4	-1	BOWL - BRZ.	-3
MAX. SPHERE SIZE = .375"	ONE STAGE WR ² = .015	5	0	BOWL - NI-RI	-4
MIN. SUBMERGENCE = 10"	K FACTOR (max) = 2.40			BOWL - S.S.	-5

Δ CONSULT FACTORY

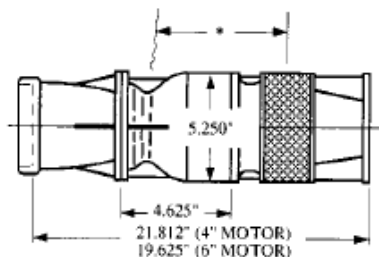

SUBMERSIBLE TURBINE