




MIXED FLOW
PUMP
PERFORMANCE

1 STAGE
#36 PUMP
500 R.P.M.
K 305.0

IMPELLERS CAN BE TRIMMED TO MEET ANY CONDITION BETWEEN LINES SHOWN.

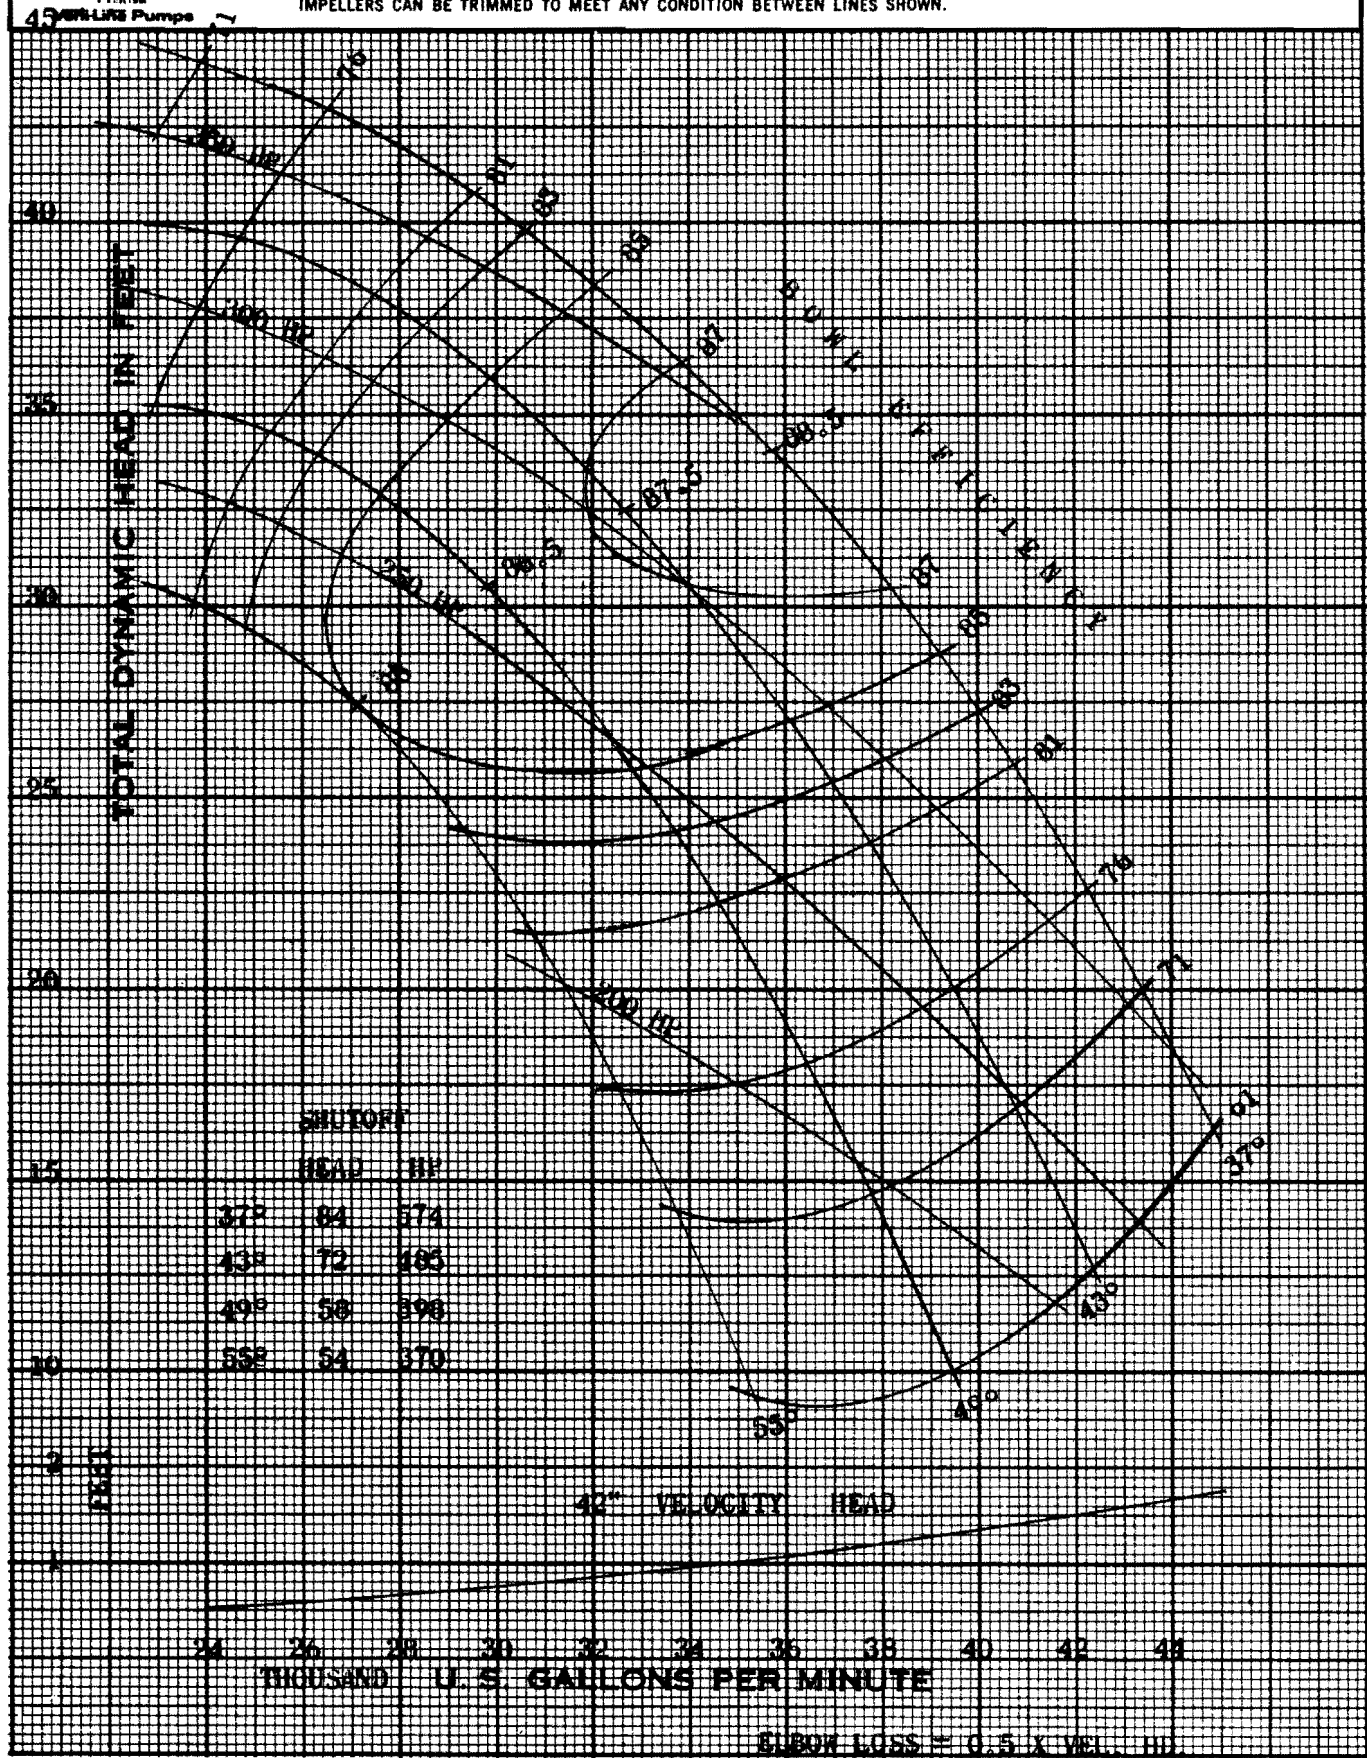




MIXED FLOW
PUMP
PERFORMANCE

1 STAGE
#36 PUMP
500 R.P.M.
K 305.0

IMPELLERS CAN BE TRIMMED TO MEET ANY CONDITION BETWEEN LINES SHOWN.

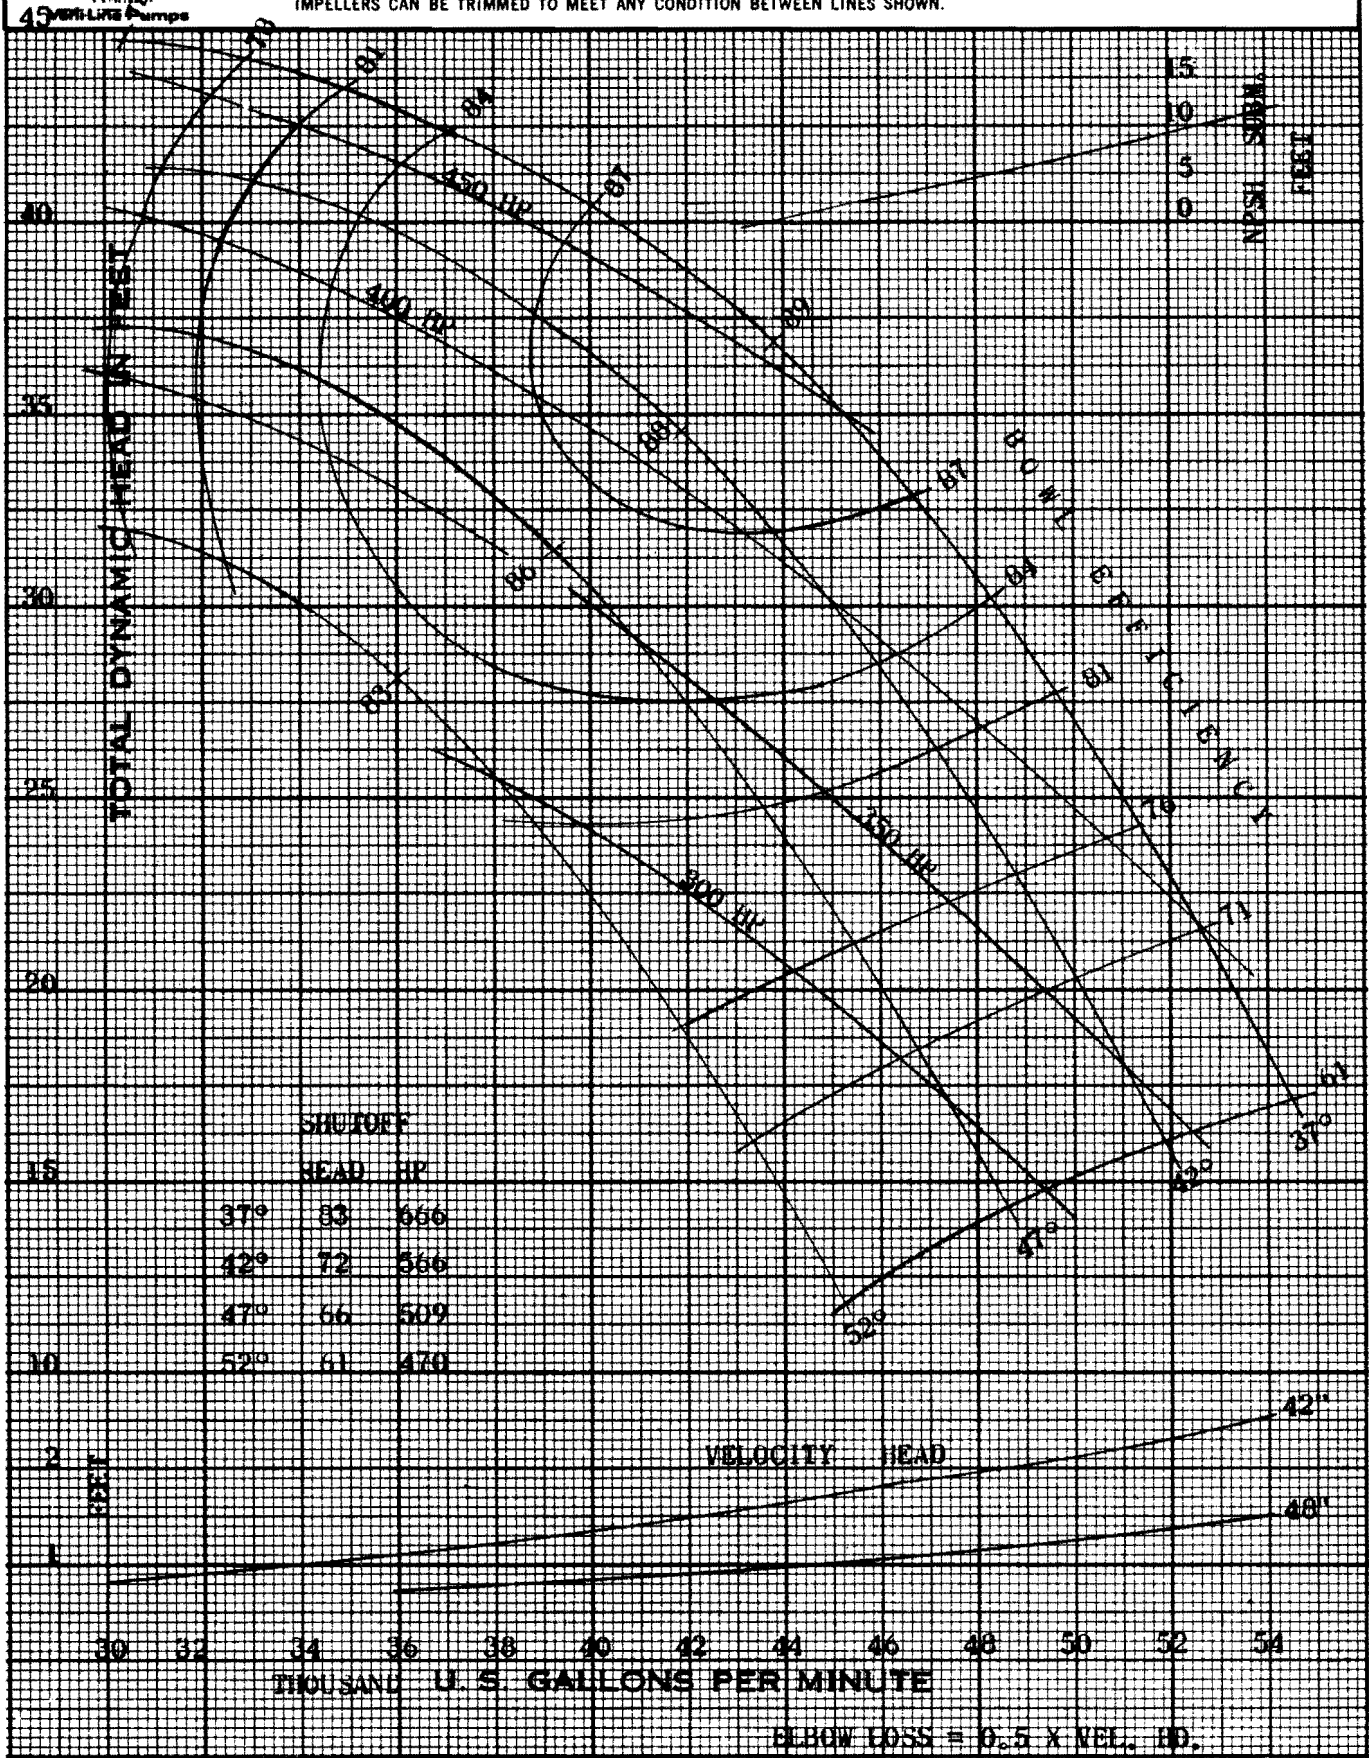

LAYNE & BOWLER PUMP COMPANY LOS ANGELES, CALIFORNIA